



AAA LEAD Consultants and Inspections, Inc.

Consulting - Inspections - Risk Assessment - Project Monitoring
STATE CERTIFIED / INSURED

©

LEAD IN WATER REPORT

FOR

**JURUPA UNIFIED SCHOOL DISTRICT
4740 PEDLEY ROAD
JURUPA VALLEY, CA 92509**

Samples Drawn At

Pacific Elementary School
Stone Avenue Elementary School
Camino Real Elementary School
Mission Middle School
Indian Hills Elementary School
Peralta Elementary School
Glen Avon Elementary School
Ina Arbuckle Elementary School

LEAD IN WATER REPORT


REPORT NUMBER: H²O-040718

INSPECTION FOR: Jurupa Unified School District
4740 Pedley Road
Jurupa Valley, Ca 92509

PERFORMED AT: Pacific Street Elementary
Stone Avenue Elementary
Camino Real Elementary School
Mission Middle School
Indian Hills Elementary School
Peralta Elementary School
Glen Avon Elementary School
Ina Arbuckle Elementary School

SAMPLE DATE: April 7, 2018

ACTION LEVEL: 15 parts per billion

SIGNED  **DATE** May 2, 2018
Michael P. Cohn
DPH #437

This inspection/ sampling was conducted in conformance with American Water Works Association Guidelines for water sampling. AAA Lead Consultants and Inspections, Inc. utilized state-of-art practices and techniques in accordance with regulatory standards while performing this inspection. AAA Lead Consultants and Inspections, Inc. evaluation of the relative risk of exposure to lead identified during this inspection is based on conditions observed at the time inspection. AAA Lead Consultants and Inspections, Inc. cannot be responsible for changing conditions that may alter the relative exposure risk or for changes in accepted methodology.

**LEAD IN WATER REPORT
JURUPA UNIFIED SCHOOL DISTRICT
4740 PEDLEY ROAD
JURUPA VALLEY, CA 92509**

1.0 INTRODUCTION

This report presents the results of AAA LEAD Consultants and Inspections lead in water sampling for eight school sites in the Jurupa Unified School District as identified on the previous page. AAA LEAD Consultants and Inspections, Inc. collected six water samples from each of the school sites including a second draw from one faucet at each site. This document is prepared for the sole use of Jurupa Unified School District, and any regulatory agencies that are directly involved in this project. No other party should rely on the information contained herein without prior written consent of Jurupa Unified School District. The scope of services and results are presented below.

2.0 SCOPE OF WORK

The purpose of this analysis was to identify and assess the presence of lead in water at each of the school campuses and if present, determine the cause and make recommendations to permanently remove the source of contamination.

On April 7, 2018 AAA Lead Consultants and Inspections obtained six water samples from each school site including kitchen sinks and drinking fountains. None of the sinks or fountains had been used since the previous day. A first and second draw was taken from a sink or fountain at each site followed by a first draw at four other locations on each campus.

3.0 PROPERTY DESCRIPTION

Each school site was unique in age and size. Most campuses had a cafeteria or food service area where some first and second draws were taken. At some schools a first and second draw were taken from high traffic fountains.

4.0 INSPECTOR'S QUALIFICATIONS

Mr. Michael Cohn of AAA LEAD Consultants and Inspections performed the water collection at the site using sterile collection containers with HNO₃ (nitric acid as a preservative) to obtain the water samples. Mr. Cohn has taken water sampling classes offered by the American Water Works Association. Mr. Cohn is certified by the California State Department of Health Services as an Inspector for Lead Based Paint. Project Monitoring, Project Supervision and Project Design.

5.0 METHOD OF TESTING

The samples were drawn into two pint water collection bottles and were sealed. The samples were taken to a State of California Department of Health Services accredited Laboratory for water analysis by EPA approved method 200.8. "Standard Methods for the Examination of Water and Wastewater 1992, 18th Edition", published by the American Public Health Association.

6.0 SUMMARY OF RESULTS

Seven of the eight schools results were non-detect for the presence of lead in water. One of the schools, Pacific Avenue Elementary School, had one fountain with detectable levels of lead. The results of this fountain is: sample H²O-3, located in Room 17 with a result of 6.6ppb. This sample is less than the Federal Standard for Lead in Drinking Water which is 15 parts per billion.

7.0 CONCLUSIONS

The sample taken at Pacific Avenue Elementary School with an identifiable amount of lead indicate the fixtures may cause lead to leach into the water after setting for a period of time. Although the detectable levels of lead are approximately one third of the Federal Standard for Lead in Drinking Water it is our recommendation this faucet should be replaced with new fixtures which does not contain lead.

8.0 REPORT LIMITATIONS

AAA LEAD Consultants and Inspections planned, developed and implemented this water sampling based on AAA LEAD Consultants and Inspections previous experience in performing lead in water sampling. This drawing of samples was conducted in conformance with American Water Works Association guidelines. AAA LEAD Consultants and Inspections utilized state-of-the-art practices and techniques in accordance with regulatory standards while performing this sampling. A copy of personnel certifications has been provided for your review. AAA LEAD Consultants and Inspections evaluation of the relative risk of exposure to lead identified during this sampling is based on laboratory analysis. AAA LEAD Consultants and Inspections cannot be responsible for changing conditions that may alter the relative exposure risk or for future changes in accepted methodology.



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Pacific Ave
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0786

Received on Ice (Y/N): No Temp: 21 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8D0786-01	H2O-1 Kitchen Sink 1st Draw	Water	04/07/18 09:50	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0786-02	H2O-2 Kitchen Sink 2nd Draw	Water	04/07/18 09:52	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0786-03	H2O-3 Room 17 Fountain	Water	04/07/18 09:54	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0786-04	H2O-4 Playground Fountain	Water	04/07/18 10:00	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0786-05	H2O-5 Room D-11 Fountain	Water	04/07/18 10:05	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0786-06	H2O-6 Restroom at Portables	Water	04/07/18 10:11	Michael Cohn	04/09/18 08:25	Sarah Geiger

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 23-Apr-2018

Analytical Report: Page 2 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Pacific Ave
 Elementary School
 Work Order Number: **B8D0786**
 Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0786-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 Kitchen Sink 1st Draw	Water	04/07/18 09:50	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 14:24	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 23-Apr-2018

Analytical Report: Page 3 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Pacific Ave
 Elementary School
 Work Order Number: **B8D0786**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0786-02

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-2 Kitchen Sink 2nd Draw	Water	04/07/18 09:52	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 14:26	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 4 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Pacific Ave
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0786**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0786-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Room 17 Fountain	Water	04/07/18 09:54	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	6.6	5.0	ug/L	EPA 200.8	04/16/18 14:29	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 5 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Pacific Ave
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0786**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0786-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Playground Fountain	Water	04/07/18 10:00	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 14:32	MEL	

mailing
 P.O Box 432
 Riverside. CA 92502-0432

location
 6100 Quail Valley Court
 Riverside. CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 6 of 8
 Project Name: Misc.

Project Number: **Jurupa** U.S.D./Pacific Ave
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0786**

Received on Ice (Y/N): **No** Temp: **21 °C**

Laboratory Reference Number

B8D0786-05

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-5 Room D-11 Fountain	Water	04/07/18 10:05	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 14:34	MEL	

mailing
 P.O Box 482
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 7 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Pacific Ave
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0786**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0786-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 Restroom at Portables	Water	04/07/18 10:11	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 14:37	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 8 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Pacific Ave
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0786

Received on Ice (Y/N): No Temp: 21 °C

Notes and Definitions

ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)

NR: Not Reported

RDL: Reportable Detection Limit

MDL: Method Detection Limit

* / " : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Cindy A. Waddell

cc:

e-Short_No Alias.rpt

This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years


Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 23-Apr-2018

Analytical Report: Page 1 of 1
 Project Name: Misc.

Project Number: Jurupa U.S.D./Pacific Ave
 Elementary School

Work Order Number: B8D0786

Received on Ice (Y/N): No Temp: 21 °C



BABCOCK
 Environmental Laboratories

6109 Quail Valley Court Riverside, CA 92507
 (951) 653-3351 - FAX (951) 653-1662
 www.babcocklabs.com

Chain of Custody & Sample Information Record

Client: AAA Lead Consultants and Inspections, Inc		Contact: Michael P. Cohn		Fax No.		Additional Reporting Requests													
Phone No. 951-582-9071		email: aaalead@sbcglobal.net		Turn Around Time: <input checked="" type="checkbox"/> Routine <input type="checkbox"/> 72 Hour Rush <input type="checkbox"/> 48 Hour Rush <input type="checkbox"/> 24 Hour Rush		Include OC Data Package <input type="checkbox"/> Yes <input type="checkbox"/> No FAX Results <input type="checkbox"/> Yes <input type="checkbox"/> No Email Results <input type="checkbox"/> Yes <input type="checkbox"/> No State EDI <input type="checkbox"/> Yes <input type="checkbox"/> No (Include Source Number in Notes)													
Project Name: Jurupa United School District		*Lab TAT Approval: _____		By: _____		*Additional Charges Apply													
Project Location: Pacific Ave Elementary School																			
Sample Information			# of Containers & Preservatives				Sample Type	Analysis Requested	Matrix	Notes									
Name: Michael Cohn			Unpreserved	HCl	HNO ₃	Na ₂ SO ₃	NaOH	NaOH/Zn Acetate	NH ₄ Cl	MCAA	Total # of Containers	Routine	Resample	Special	Lead				
Employer: AAA Lead Consultants and Inspections, Inc.																			
Signature: <i>[Signature]</i>																			
Sample ID	Date	Time																	
H2O-1 Kitchen Sink 1st Draw	4/7/18	09:50									1							DW	
H2O-2 Kitchen Sink 2nd Draw	4/7/18	9:52									1							DW	
H2O-3 Room 17 Fountain	4/7/18	9:54									1							DW	
H2O-4 Playground Fountain	4/7/18	10:00									1							DW	
H2O-5 Room D-11 Fountain	4/7/18	10:05									1							DW	
H2O-6 Restroom at Portables	4/7/18	10:11									1							DW	
Signature: <i>[Signature]</i>	Print Name / Company		Date / Time		Received By (sign)		Print Name / Company												
<i>[Signature]</i>	Michael Cohn / AAA Lead		4/8/18 4:00pm		<i>[Signature]</i>		AAA Lead, Sarah Geiger												
<i>[Signature]</i>	Sarah Geiger / AAA Lead		4/9/18 8:25		<i>[Signature]</i>		Carpenter / AAA Lead												

Sample Integrity Upon Receipt/Acceptance Criteria

Sample properly stored and sealed?	Yes / No	Sample meets laboratory acceptance criteria?	Yes / No
Container sealed and labeled?	Yes / No / NA	Permission to continue:	Yes / No
Sample integrity maintained?	Yes / No	Deviation/Notes: <i>[Handwritten]</i>	<i>[Handwritten]</i>
Temperature: _____ °C <input type="checkbox"/> Cooler Blank		Signature/Date: <i>[Signature]</i>	

Lab No. B8D0786 NGU

Logged in By/Date: APR 09 2018


Page 1 of 1

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119

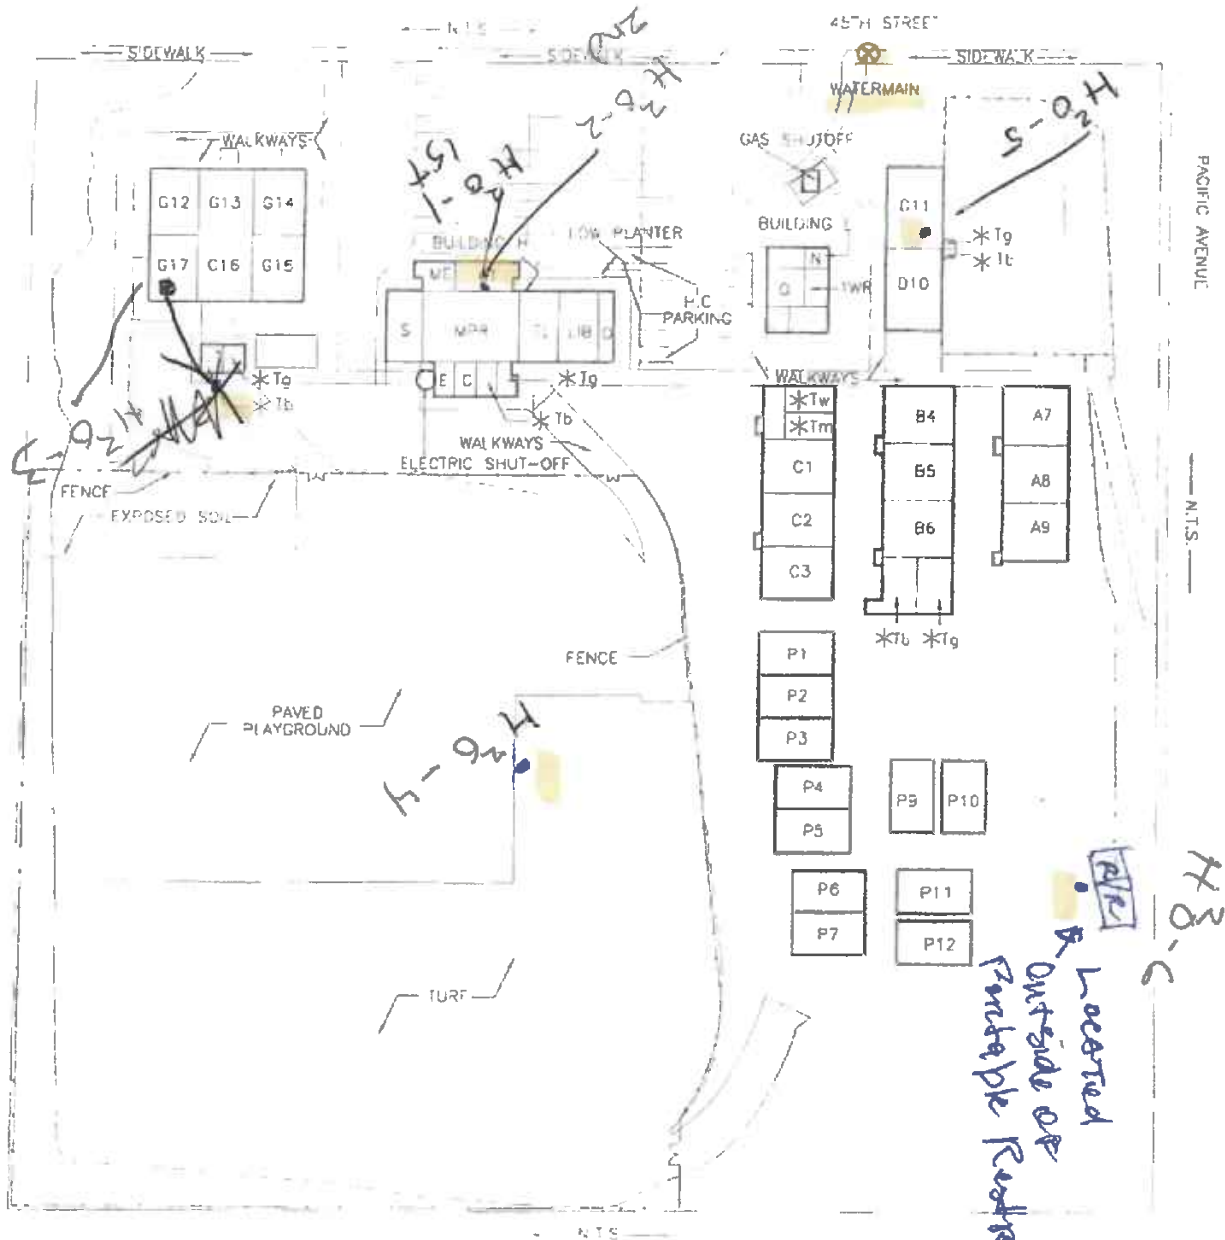

HARDING ST
 HO STAIRS
 HO WAY STAIRS

*Located
 Outside of
 Portable Restroom*

P E R T I K S
 & W I L L S

PACIFIC AVENUE ELEM SCHOOL
 EXISTING CONDITIONS
 6110 45th St
 Sunrise Valley 92509

Date: 02/05/02
 Project Number: 29814 00
 Scale: 1" = 100' 0"
 Plot Number:



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 23-Apr-2018

Analytical Report: Page 1 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Stone Ave
 Elementary School
 Work Order Number: **B8D0790**

Received on Ice (Y/N): No Temp: 21 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8D0790-01	H2O-1 Room 1 Fountain 1st Draw	Water	04/07/18 08:24	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0790-02	H2O-2 Room 1 Fountain 2nd Draw	Water	04/07/18 08:28	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0790-03	H2O-3 Kitchen Sink Over Disposal	Water	04/07/18 08:33	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0790-04	H2O-4 Playground Fountain	Water	04/07/18 08:37	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0790-05	H2O-5 Fountain Between P25 & P26	Water	04/07/18 08:43	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0790-06	H2O-6 Fountain Hall Off Rm 12	Water	04/07/18 08:47	Michael Cohn	04/09/18 08:25	Sarah Geiger

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 2 of 8
 Project Name: Misc.

Project Number: **Jurupa U.S.D./Stone Ave
 Elementary School**

Report Date: 23-Apr-2018

Work Order Number: B8D0790

Received on Ice (Y/N): **No** Temp: **21 °C**

Laboratory Reference Number

B8D0790-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 Room 1 Fountain 1st Draw	Water	04/07/18 08:24	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 15:06	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 3 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Stone Ave
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0790

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0790-02

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-2 Room 1 Fountain 2nd Draw	Water	04/07/18 08:28	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:34	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 4 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Stone Ave
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0790**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0790-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Kitchen Sink Over Disposal	Water	04/07/18 08:33	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:36	MEL	

mailing
 P.O Box 432
 Riverside. CA 92502-0432

location
 6100 Quail Valley Court
 Riverside. CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 5 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Stone Ave
Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0790**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0790-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Playground Fountain	Water	04/07/18 08:37	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:42	MEL	

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 6 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Stone Ave
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0790

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0790-05

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-5 Fountain Between P25 & P26	Water	04/07/18 08:43	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:43	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 7 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Stone Ave
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0790**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0790-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 Fountain Hall Off Rm 12	Water	04/07/18 08:47	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:45	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.

The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.

Contact: Mike Cohn

Address: 1307 West Sixth Street

Corona, CA 92882

Report Date: 23-Apr-2018

Analytical Report: Page 8 of 8

Project Name: Misc.

Project Number: Jurupa U.S.D./Stone Ave
Elementary School

Work Order Number: B8D0790

Received on Ice (Y/N):

No

Temp: 21 °C

Notes and Definitions

ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)

NR: Not Reported

RDL: Reportable Detection Limit

MDL: Method Detection Limit

* / " : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Cindy A. Waddell

cc:

e-Short_No Alias.rpt

This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing

P.O Box 432

Riverside, CA 92502-0432

location

6100 Quail Valley Court

Riverside, CA 92507-0704

P 951 653 3351

F 951 653 1662

www.babcocklabs.com

CA ELAP No. 2698

EPA No. CA00102

NELAP No. OR4035

LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years


Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 1 of 1
Project Name: Misc.
Project Number: Jurupa U.S.D./Stone Ave
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0790

Received on Ice (Y/N): No Temp: 21 °C



BABCOCK
Environmental Laboratories

6100 Quail Valley Court Riverside, CA 92507
(951) 653-3351 • FAX (951) 653-1662
www.babcocklabs.com

Chain of Custody & Sample Information Record

Client: AAA Lead Consultants and Inspections, Inc		Contact: Michael P. Cohn		Fax No.		Additional Reporting Requests												
Phone No. 951-592-9971		Email: aaalead@sbcglobal.net		Turn Around Time: <input checked="" type="checkbox"/> Routine <input type="checkbox"/> 72 Hour Rush <input type="checkbox"/> 48 Hour Rush <input type="checkbox"/> 24 Hour Rush		Include OC Data Package: <input type="checkbox"/> Yes <input type="checkbox"/> No FAX Results: <input type="checkbox"/> Yes <input type="checkbox"/> No Email Results: <input type="checkbox"/> Yes <input type="checkbox"/> No State EDT: <input type="checkbox"/> Yes <input type="checkbox"/> No (Include Source Number in Notes)												
Project Name: Jurupa Unified School District		*Lab TAT Approval: By:		*Additional Charges Apply														
Project Location: Stone Ave Elementary School																		
Sampler Information		# of Containers & Preservatives				Sample Type	Analysis Requested	Matrix	Notes									
Name: Michael Cohn		Unpreserved	H2SO4	HNO3	Na2S2O8	NaOH	NaOH/Zn Acetate	NH4Cl	MCAA	Total # of Containers	Routine	Resample	Special	Lead				
Employer: AAA Lead Consultants and Inspections, Inc																		
Signature: <i>[Signature]</i>																		
Sample ID	Date	Time																
H2O-1 Room 1 Fountain 1st Draw	4/7/18	08:24								1								DW
H2O-2 Room 1 Fountain 2nd Draw	4/7/18	08:28								1								DW
H2O-3 Kitchen Sink over Disposal	4/7/18	08:33								1								DW
H2O-4 Playground Fountain	4/7/18	08:37								1								DW
H2O-5 Fountain between P25 & P26	4/7/18	08:43								1								DW
H2O-6 Fountain Hall off Rm 12	4/7/18	08:47								1								DW

Signature: <i>[Signature]</i>	Print Name / Company: Michael Cohn / AAA Lead	Date / Time: 4/9/18 4:00pm	Received By (sign): <i>[Signature]</i>	Print Name / Company: AAA Lead / Sarah Ganger
Signature: <i>[Signature]</i>	Print Name / Company: Sarah Ganger / AAA Lead	Date / Time: 4/9/18 3:25 PM	Received By (sign): <i>[Signature]</i>	Print Name / Company: AAA Lead / Sarah Ganger

Lab No. B8D0790-060

Logged in By/Date: APR 09 2018

Page 1 of 1


Re: 300

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119

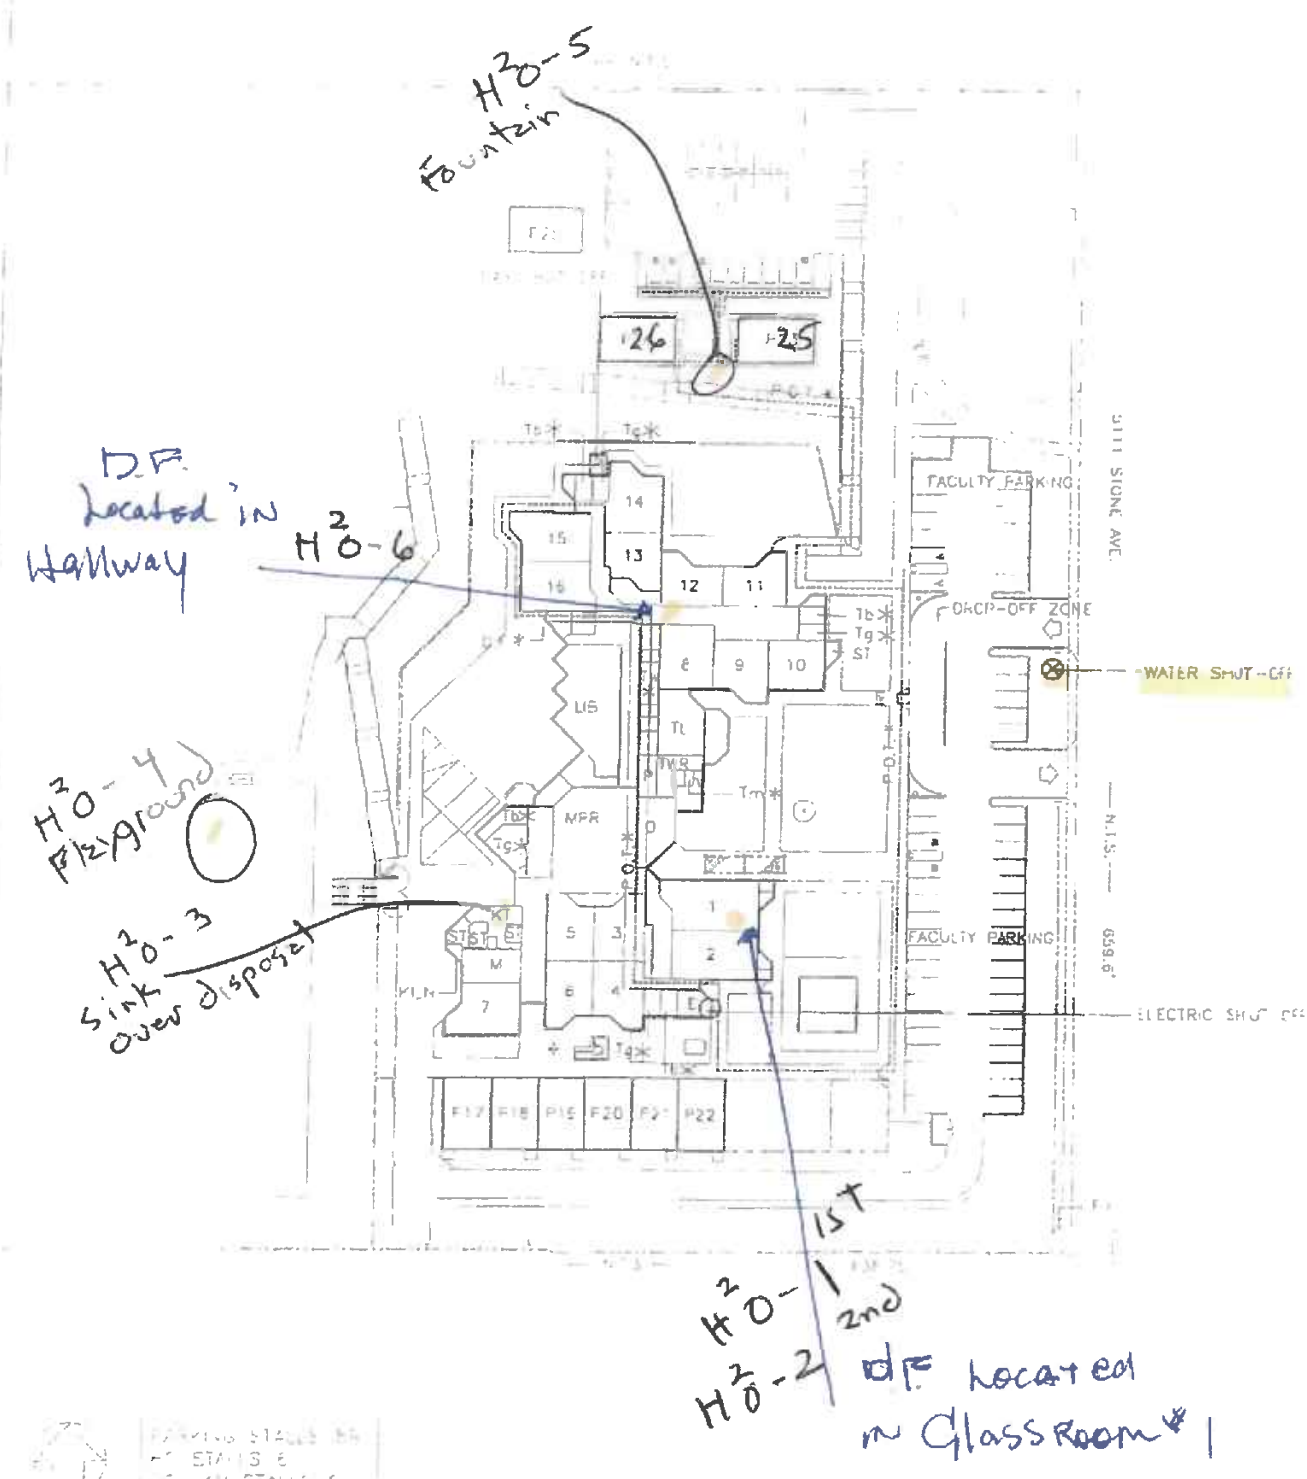

PARKING STALLS 88
 STALLS 8
 STALLS 2

P E R K I N S
 & W I L L

STONE AVENUE LEAD SYSTEM
 EXISTING DRAWINGS
 5111 Stone Avenue
 Riv. La 72509

Date: 02/05/07
 Project Number: 49814-00
 Scale: 1" = 10' 0"



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Camino Real
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0798

Received on Ice (Y/N): No Temp: 21 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8D0798-01	H2O-1 Kitchen Sink 1st Draw	Water	04/07/18 07:45	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0798-02	H2O-2 Kitchen Sink 2nd Draw	Water	04/07/18 07:47	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0798-03	H2O-3 Library Ext Fountain	Water	04/07/18 07:52	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0798-04	H2O-4 Room B-15 Fountain	Water	04/07/18 07:55	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0798-05	H2O-5 Fountain At RR Near Rm 17	Water	04/07/18 08:00	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0798-06	H2O-6 Fountain In Playground	Water	04/07/18 08:04	Michael Cohn	04/09/18 08:25	Sarah Geiger

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 2 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Camino Real
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0798

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0798-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 Kitchen Sink 1st Draw	Water	04/07/18 07:45	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:47	MEL	

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR-1035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 3 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Camino Real
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0798**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0798-02

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-2 Kitchen Sink 2nd Draw	Water	04/07/18 07:47	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:48	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 4 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Camino Real
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0798

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0798-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Library Ext Fountain	Water	04/07/18 07:52	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:50	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 5 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Camino Real
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0798**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0798-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Room B-15 Fountain	Water	04/07/18 07:55	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:51	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 6 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Camino Real
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0798

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0798-05

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-5 Fountain At RR Near Rm 17	Water	04/07/18 08:00	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:53	MEL	

mailing
P.O Box 432
Riverside. CA 92502-0432

location
6100 Quail Valley Court
Riverside. CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 7 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Camino Real
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0798

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0798-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 Fountain In Playground	Water	04/07/18 08:04	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:54	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 8 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Camino Real
Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0798**

Received on Ice (Y/N): No Temp: 21 °C

Notes and Definitions

- ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR: Not Reported
- RDL: Reportable Detection Limit
- MDL: Method Detection Limit
- * / " : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Cindy A. Waddell

cc:

e-Short_No Alias.rpt

This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years


Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 1 of 1
Project Name: Misc.
Project Number: Jurupa U.S.D./Camino Real
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0798

Received on Ice (Y/N): No Temp: 21 °C



BABCOCK
Environmental Laboratories

6100 Quail Valley Court Riverside, CA 92507
(951) 653-3351 • FAX (951) 653-1662
www.babcocklabs.com

Chain of Custody & Sample Information Record

Client: AAA Lead Consultants and Inspections, Inc.	Contact: Michael P. Cohn	Fax No.	Additional Reporting Requests
Phone No: 951-582-9071	Email: aaalead@stcglobal.net		Include CC Data Package: <input type="checkbox"/> Yes <input type="checkbox"/> No
Project Name: Jurupa Unified School District	Turn Around Time: <input checked="" type="checkbox"/> Routine <input type="checkbox"/> 72 Hour Rush <input type="checkbox"/> 48 Hour Rush <input type="checkbox"/> 24 Hour Rush		Final Results: <input type="checkbox"/> Yes <input type="checkbox"/> No
Project Location: Camino Real Elementary School	*Lab TAT Approval: By: *Additional Charges Apply		State EDT: <input type="checkbox"/> Yes <input type="checkbox"/> No

Sample ID	Date	Time	# of Containers & Preservatives							Total # of Containers	Sample Type	Analysis Requested	Matrix	Notes
			Unpreserved	HCl	HNO ₃	Na ₂ S ₂ O ₃	NaOH	NaOH/Zn Acetate	NH ₄ Cl					
H2O-1 Kitchen Sink 1st Draw	4/7/18	07:45							1	Routine		DW		
H2O-2 Kitchen Sink 2nd Draw	4/7/18	07:47							1	Resample		DW		
H2O-3 Library Ext Fountain	4/7/18	07:52							1	Special		DW		
H2O-4 Room B-15 Fountain	4/7/18	07:55							1	Lead		DW		
H2O-5 Fountain at RR near Rm 17	4/7/18	08:00							1			DW		
H2O-6 Fountain in Playground	4/7/18	08:04							1			DW		

Collected By (Sign)	Print Name / Company	Date / Time	Received By (Sign)	Print Name / Company
<i>[Signature]</i>	Michael Cohn / AAA Lead	4/8/18 4:50pm	<i>[Signature]</i>	Sarah Greigert / AAA Lead
<i>[Signature]</i>	Sarah Greigert / AAA Lead	4/9/18 3:25	<i>[Signature]</i>	Harjit Dhillon / AAA Lead

Sample Integrity Upon Receipt/Acceptance Criteria

Sample(s) Contamination Free?	Yes () No ()	Sample meets laboratory acceptance criteria?	Yes () No ()
Customer's Initials/Signature?	Yes () No ()	Permission to continue:	Yes () No ()
Temperature (C):	21 °C <input type="checkbox"/> Cooler Blank	Deviation/Notes:	OK Temp > 20C
Signature/Date:	<i>[Signature]</i>	Signature/Date:	<i>[Signature]</i>

Lab No: B8D0798 NGU
Logged in By/Date: APR 09 2018
Page 1 of 1

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com


CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR-0035
LACSD No. 10119



CAMINO REAL ELEMENTARY SCHOOL

4655 CAMINO REAL, JURUPA VALLEY, CA 92509

PHONE (951) 360-2714 FAX (951) 360-2819

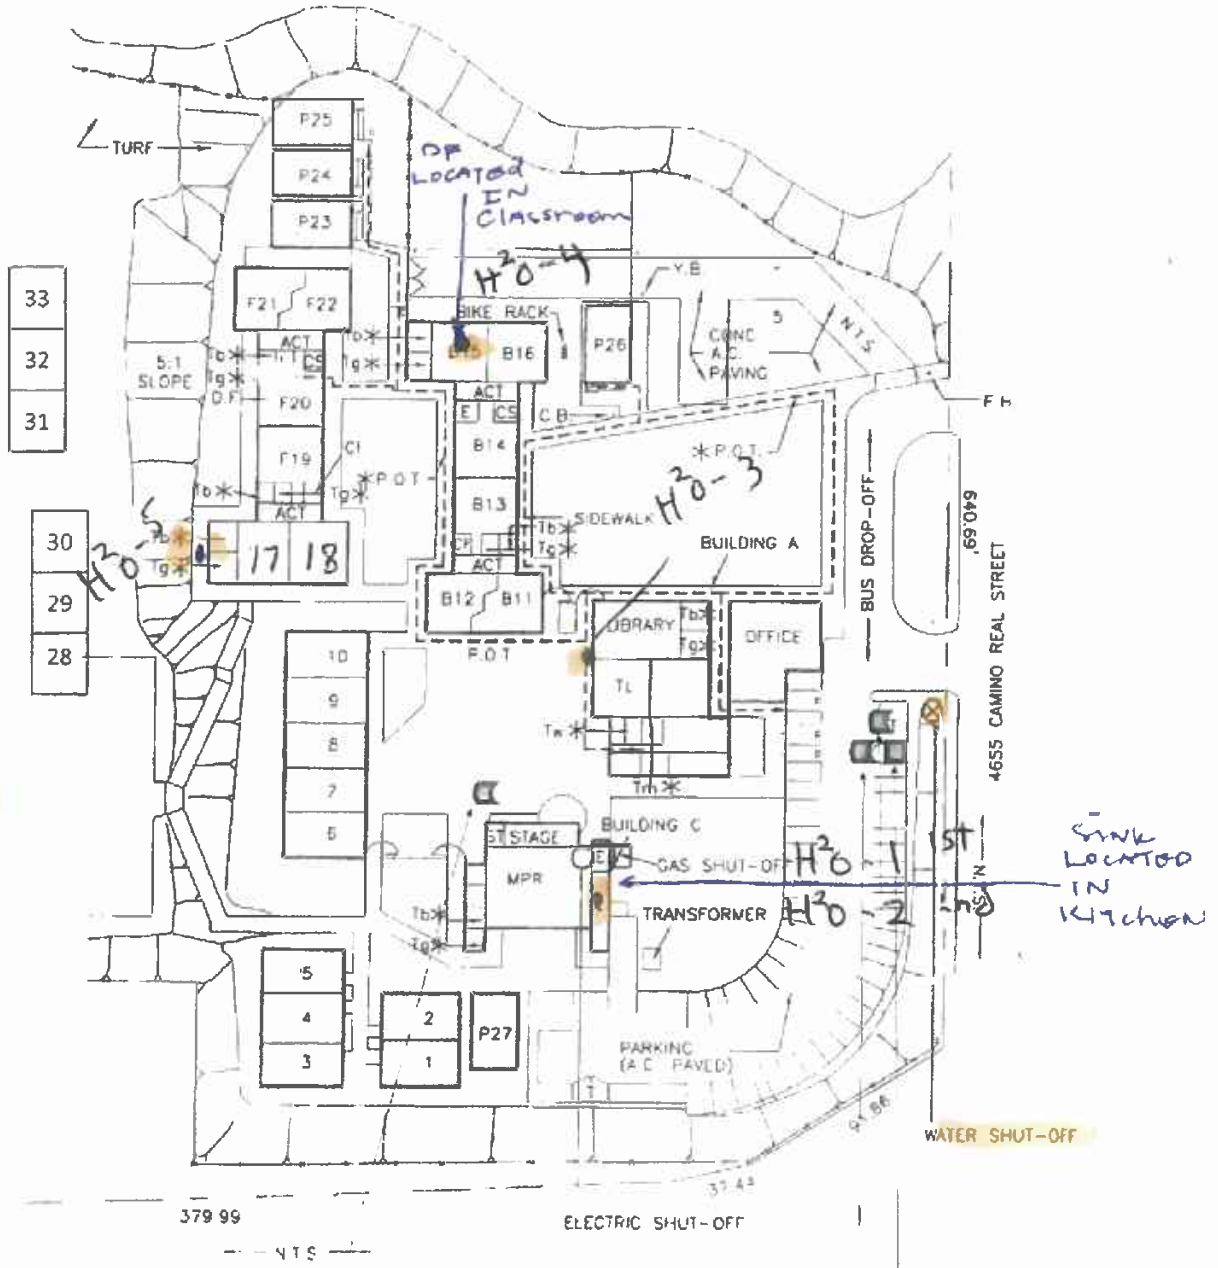

PARKING STALLS	43
HC STALLS	2
HC VAR STALLS	

- BACKFLOW SUTS OFF IRRIGATION
- METER SHUTS OFF ENTIRE SITE
- BACKFLOW SHUTS OFF DOMESTIC
- SHUTS OFF FIRE SPRINKLERS



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Mission Middle School

Report Date: 23-Apr-2018

Work Order Number: B8D0788

Received on Ice (Y/N): No Temp: 21 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8D0788-01	H2O-1 Fountain At Comp	Water	04/07/18 09:10	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0788-02	H2O-2 Bldg G Side "C" "R" Fountain	Water	04/07/18 09:13	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0788-03	H2O-3 Kitchen Sink "C" "C" 1st Draw	Water	04/07/18 09:18	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0788-04	H2O-4 Kitchen Sink "C" "C" 2nd Draw	Water	04/07/18 09:21	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0788-05	H2O-5 PE Bldg "C" "R" Fountain	Water	04/07/18 09:30	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0788-06	H2O-6 RR Bldg Fountain "B" "C"	Water	04/07/18 09:54	Michael Cohn	04/09/18 08:25	Sarah Geiger

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babrocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 2 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Mission Middle School

Report Date: 23-Apr-2018

Work Order Number: **B8D0788**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0788-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 Fountain At Comp	Water	04/07/18 09:10	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 14:40	MEL	

mailing
P.O Box 432
Riverside. CA 92502-0432

location
6100 Quail Valley Court
Riverside. CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 3 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Mission Middle School

Report Date: 23-Apr-2018

Work Order Number: B8D0788

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0788-02

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-2 Bldg G Side "C" "R" Fountain	Water	04/07/18 09:13	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 14:42	MEL	

mailing
P.O Box 432
Riverside. CA 92502-0432

location
6100 Quail Valley Court
Riverside. CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 4 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Mission Middle School

Report Date: 23-Apr-2018

Work Order Number: B8D0788

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0788-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Kitchen Sink "C" "C" 1st Draw	Water	04/07/18 09:18	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 14:56	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 5 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Mission Middle School

Report Date: 23-Apr-2018

Work Order Number: B8D0788

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0788-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Kitchen Sink "C" "C" 2nd Draw	Water	04/07/18 09:21	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 14:58	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 6 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Mission Middle School

Report Date: 23-Apr-2018

Work Order Number: B8D0788

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0788-05

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-5 PE Bldg "C" "R" Fountain	Water	04/07/18 09:30	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 15:01	MEL	

mailing
 P.O Box 432
 Riverside. CA 92502-0432

location
 6100 Quail Valley Court
 Riverside. CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 7 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Mission Middle School

Report Date: 23-Apr-2018

Work Order Number: B8D0788

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0788-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 RR Bldg Fountain "B" "C"	Water	04/07/18 09:54	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/16/18 15:03	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 8 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Mission Middle School

Report Date: 23-Apr-2018

Work Order Number: B8D0788

Received on Ice (Y/N): No Temp: 21 °C

Notes and Definitions

- ND:** Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR:** Not Reported
- RDL:** Reportable Detection Limit
- MDL:** Method Detection Limit
- * / " " :** NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Cindy A. Waddell

cc:

e-Short_No Alias.rpt

This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years


Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 1 of 1
Project Name: Misc.
Project Number: Jurupa U.S.D./Mission Middle School

Report Date: 23-Apr-2018

Work Order Number: B8D0788

Received on Ice (Y/N): No Temp: 21 °C



BABCOCK
Environmental Laboratories

6100 Quail Valley Court Riverside, CA 92507
(951) 653-3351 • FAX (951) 653-1662
www.babcocklabs.com

Chain of Custody & Sample Information Record

Client: AAA Lead Consultants and Inspections, Inc.		Contact: Michael P. Cohn		Fax No.		Additional Reporting Requests													
Phone No. 951-552-9071		email: aaalead@sbcglobal.net				<input type="checkbox"/> Include GC Data Package: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> FAX Results: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Onsite Results: <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> State EDT: <input type="checkbox"/> Yes <input type="checkbox"/> No <small>(Include Source Number in Notes)</small>													
Project Name: Jurupa Unified School District		Turn Around Time: <input checked="" type="checkbox"/> Routine <input type="checkbox"/> 72 Hour Rush <input type="checkbox"/> 48 Hour Rush <input type="checkbox"/> 24 Hour Rush																	
Project Location: Mission Middle School		*Lab TAT Approval: By:		*Additional Charges Apply															
Sample Information		# of Containers & Preservatives				Sample Type	Analysis Requested	Matrix	Notes										
Client: Michael Cohn		Unpreserved	H ₂ SO ₄	HCl	HNO ₃	Na ₂ SO ₄	NaOH	NaOH/Zn Acetate	NH ₄ Cl	MCAA	Total # of Containers	Routine	Resample	Special	Lead				
Employee: AAA Lead Consultants and Inspections, Inc.																			
Signature: <i>Michael Cohn</i>																			
Sample ID:																			
H2O-1 Fountain at Comp		4/7/18	09:10								1								DW
H2O-2 Bldg G Side "C" "R" Fountain		4/7/18	09:13								1								DW
H2O-3 Kitchen Sink "C" "C" 1st Draw		4/7/18	09:18								1								DW
H2O-4 Kitchen Sink "C" "C" 2nd Draw		4/7/18	09:21								1								DW
H2O-5 PE Bldg "C" "R" Fountain		4/7/18	09:30								1								DW
H2O-6 RR Bldg Fountain "B" "C"		4/7/18	09:54								1								DW

Signature: <i>Sarah Geiger</i>		Print Name / Company: Sarah Geiger / AAA Lead		Date / Time: 4/19/18 3:25		Received By (sign): <i>[Signature]</i>		Print Name / Company: Sarah Geiger / AAA Lead	
Signature: <i>[Signature]</i>		Print Name / Company: Michael Cohn / AAA Lead		Date / Time: 4/18/18 9:00am		Received By (sign): <i>[Signature]</i>		Print Name / Company: Michael Cohn / AAA Lead	

Lab No: B8D0788 NGU
Logged in By/Date: APR 19 2018
Page of

Sample Integrity Upon Receipt/Acceptance Criteria


Sample(s) Container(s) sealed?	Yes	No	Sample meets laboratory acceptance criteria?	Yes	No
Container(s) properly labeled?	Yes	No	Permission to continue:	Yes	No
Transfer of sample?	Yes	No	Deviation/Notes: <i>Temp > 70° - Michael</i>		
Temperature:	21 °C	<input type="checkbox"/> Cooler Blank	Signature/Date: <i>[Signature]</i> 4/19/18		

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR1035
LACSD No. 10119

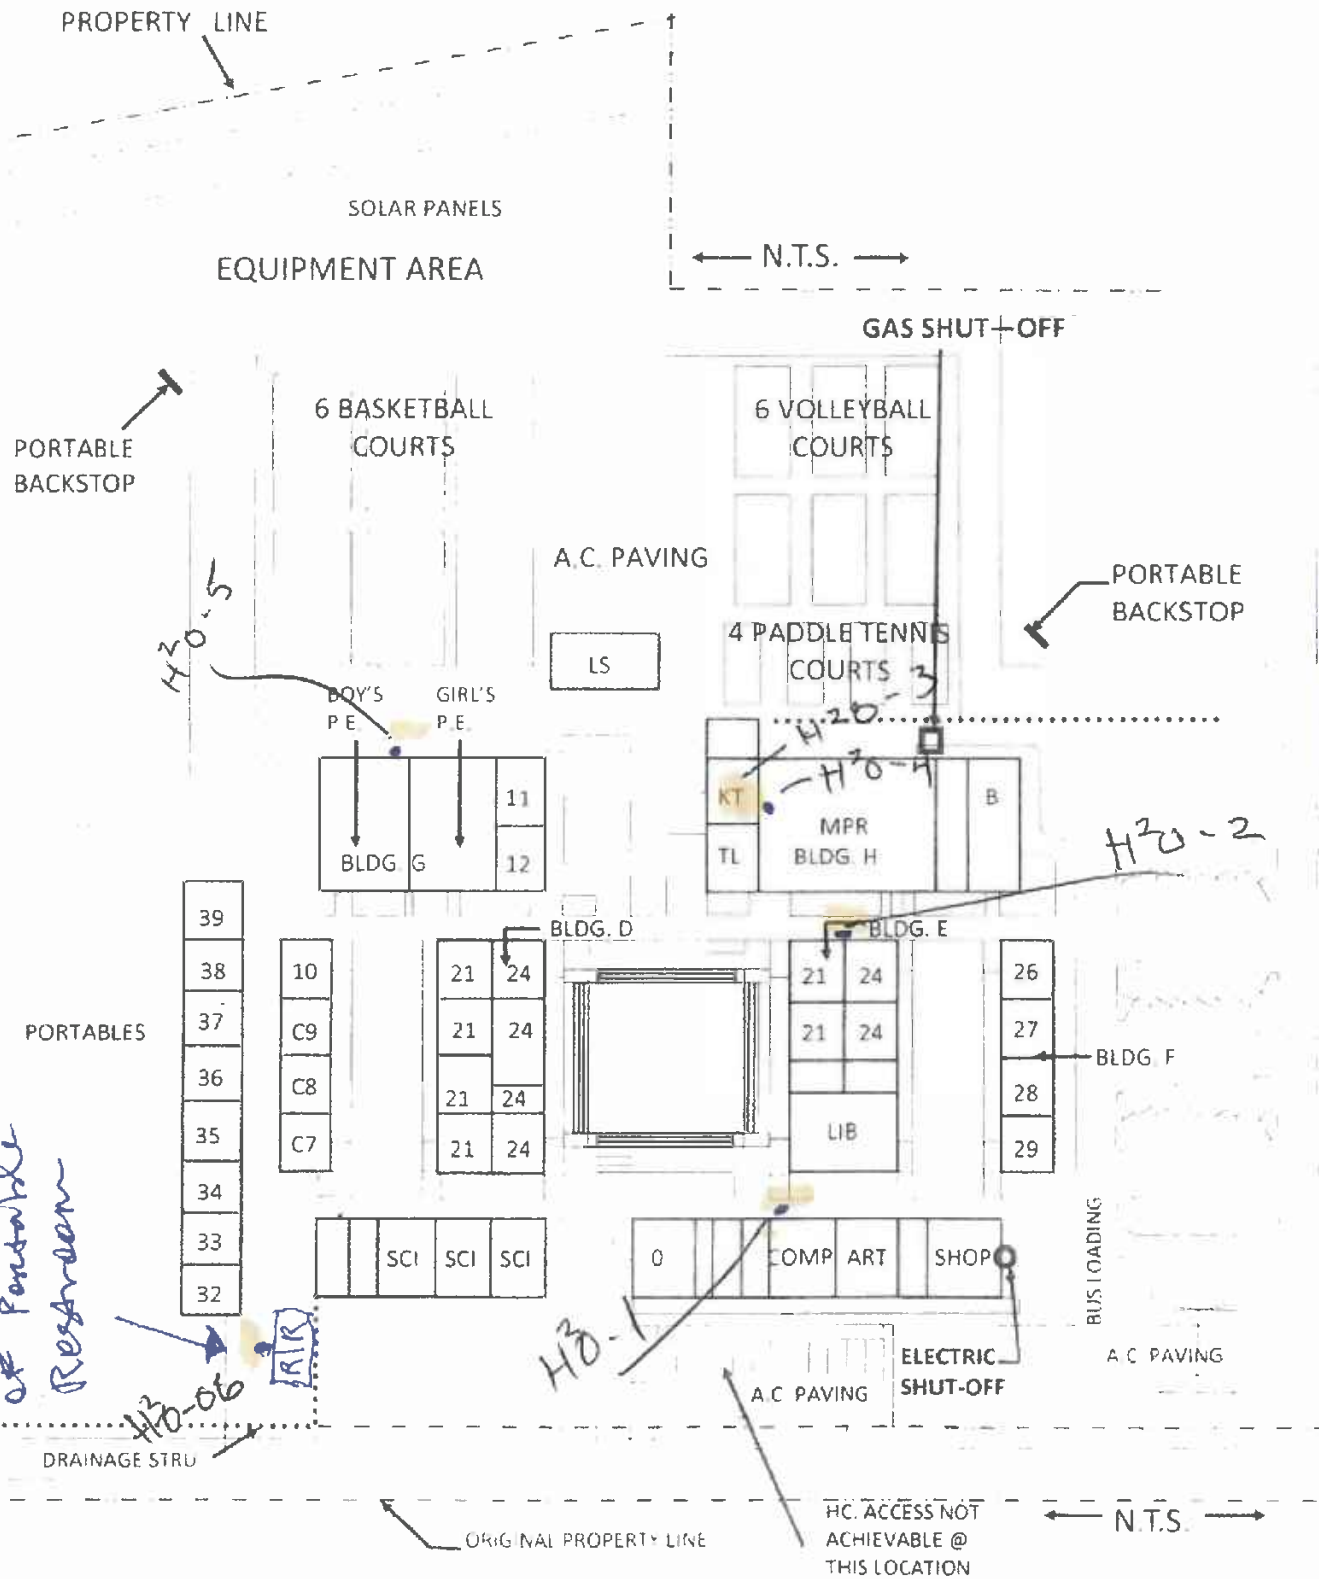

Located outside of portable Restroom

Water Main

La Rue St



MISSION MIDDLE SCHOOL
 5961 MUSTANG LANE, JURUPA VALLEY, CA 92509
 PHONE (951) 222-7842





BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Indian Hills
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0817

Received on Ice (Y/N): No Temp: 21 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8D0817-01	H2O-1 Fountain At Bike Rack	Water	04/07/18 06:52	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0817-02	H2O-2 Paved Playground Fountain	Water	04/07/18 06:55	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0817-03	H2O-3 Field RR Fountain	Water	04/07/18 06:58	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0817-04	H2O-4 Kitchen Sink 1st Draw	Water	04/07/18 07:04	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0817-05	H2O-5 Kitchen 2nd Draw	Water	04/07/18 07:06	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0817-06	H2O-6 Fountain In Hall At Rm 1 & Rm 2	Water	04/07/18 07:09	Michael Cohn	04/09/18 08:25	Sarah Geiger

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 2 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Indian Hills
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0817

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0817-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 Fountain At Bike Rack	Water	04/07/18 06:52	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 11:56	MEL	

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 3 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Indian Hills
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0817**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0817-02

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-2 Paved Playground Fountain	Water	04/07/18 06:55	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:02	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 4 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Indian Hills
Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0817**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0817-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Field RR Fountain	Water	04/07/18 06:58	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:04	MEL	

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 5 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Indian Hills
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0817

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0817-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Kitchen Sink 1st Draw	Water	04/07/18 07:04	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:05	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 658 3351
 F 951 658 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 6 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Indian Hills
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0817

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0817-05

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-5 Kitchen 2nd Draw	Water	04/07/18 07:06	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:07	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 658 3351
 F 951 658 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR-4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 7 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Indian Hills
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0817

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0817-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 Fountain In Hall At Rm 1 & Rm 2	Water	04/07/18 07:09	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:08	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
A Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 8 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Indian Hills
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0817

Received on Ice (Y/N): No Temp: 21 °C

Notes and Definitions

- ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR: Not Reported
- RDL: Reportable Detection Limit
- MDL: Method Detection Limit
- * / " : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Cindy A. Waddell

cc:

e-Short_No Alias.rpt

This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882


Analytical Report: Page 1 of 1
Project Name: Misc.

Project Number: Jurupa U.S.D./Indian Hills Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0817

Received on Ice (Y/N): No Temp: 21 °C



BABCOCK
Environmental Laboratories
6100 Quail Valley Court Riverside, CA 92507
(951) 653-3351 • FAX (951) 653-1662
www.babcocklabs.com

Chain of Custody & Sample Information Record

Client: AAA Lead Consultants and Inspections, Inc. Contact: Michael P. Cohn Fax: No
Phone: No 951-582-9371 Email: aaalead@sbcglobal.net
Project Name: Jurupa Unified School District Turn Around Time: Routine 72 Hour Rush 48 Hour Rush 24 Hour Rush
Project Location: Indian Hills Elementary School #Lab TAT Approval: By: Additional Charges Apply

Additional Reporting Requests:
Include QC Data Package: Yes No
FAX Results: Yes No
Email Results: Yes No
State EUI: Yes No
(Include Source Number in Labels)

Sample Information			# of Containers & Preservatives							Sample Type	Analysis Requested	Matrix	Notes						
Name	Date	Time	Unpreserved	H ₂ SO ₄	HCl	HNO ₃	Na ₂ SO ₃	NaOH	NaOH/Zn Acetate	NH ₄ Cl	MCAA	Total # of Containers	Routine	Resample	Special	Lead			
H2O-1 Fountain at Bike Rack	4/7/18	06:52										1						DW	
H2O-2 Paved Playground Fountain	4/7/18	06:55										1						DW	
H2O-3 Field RR Fountain	4/7/18	06:58										1						DW	
H2O-4 Kitchen Sink 1st Draw	4/7/18	07:04										1						DW	
H2O-5 Kitchen 2nd Draw	4/7/18	07:06										1						DW	
H2O-6 Fountain in Hall a: Rm 1 & Rm 2	4/7/18	07:09										1						DW	

Collected By (sign) <i>Michael Cohn</i>	Print Name / Company Michael Cohn / AAA Lead	Date / Time 4/8/18 4:00pm	Received By (sign) <i>Sarah Geiger</i>	Print Name / Company Sarah Geiger / AAA Lead
Approved By (sign) <i>Sarah Geiger</i>	Print Name / Company Sarah Geiger / AAA Lead	Date / Time 4/9/18 3:25pm	Received By (sign) <i>Michael Cohn</i>	Print Name / Company Michael Cohn / AAA Lead

Sample Integrity Upon Receipt/Acceptance Criteria

Sample(s) submitted on ice?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Sample meets laboratory acceptance criteria?	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container sealed at time?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Permission to continue:	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample(s) frozen?	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Deviation/Notes: <i>OK Temp 21°C</i>	
Temperature:	°C <input type="checkbox"/> Cooler Blank <input type="checkbox"/>	Signature/Date: <i>AP 4/9/18</i>	

Lab No: B8D0817-NGU
Logged in By/Date: *AP 4/9/2018*
Page 1 of 1


mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119

770.61' — N.T.S. —

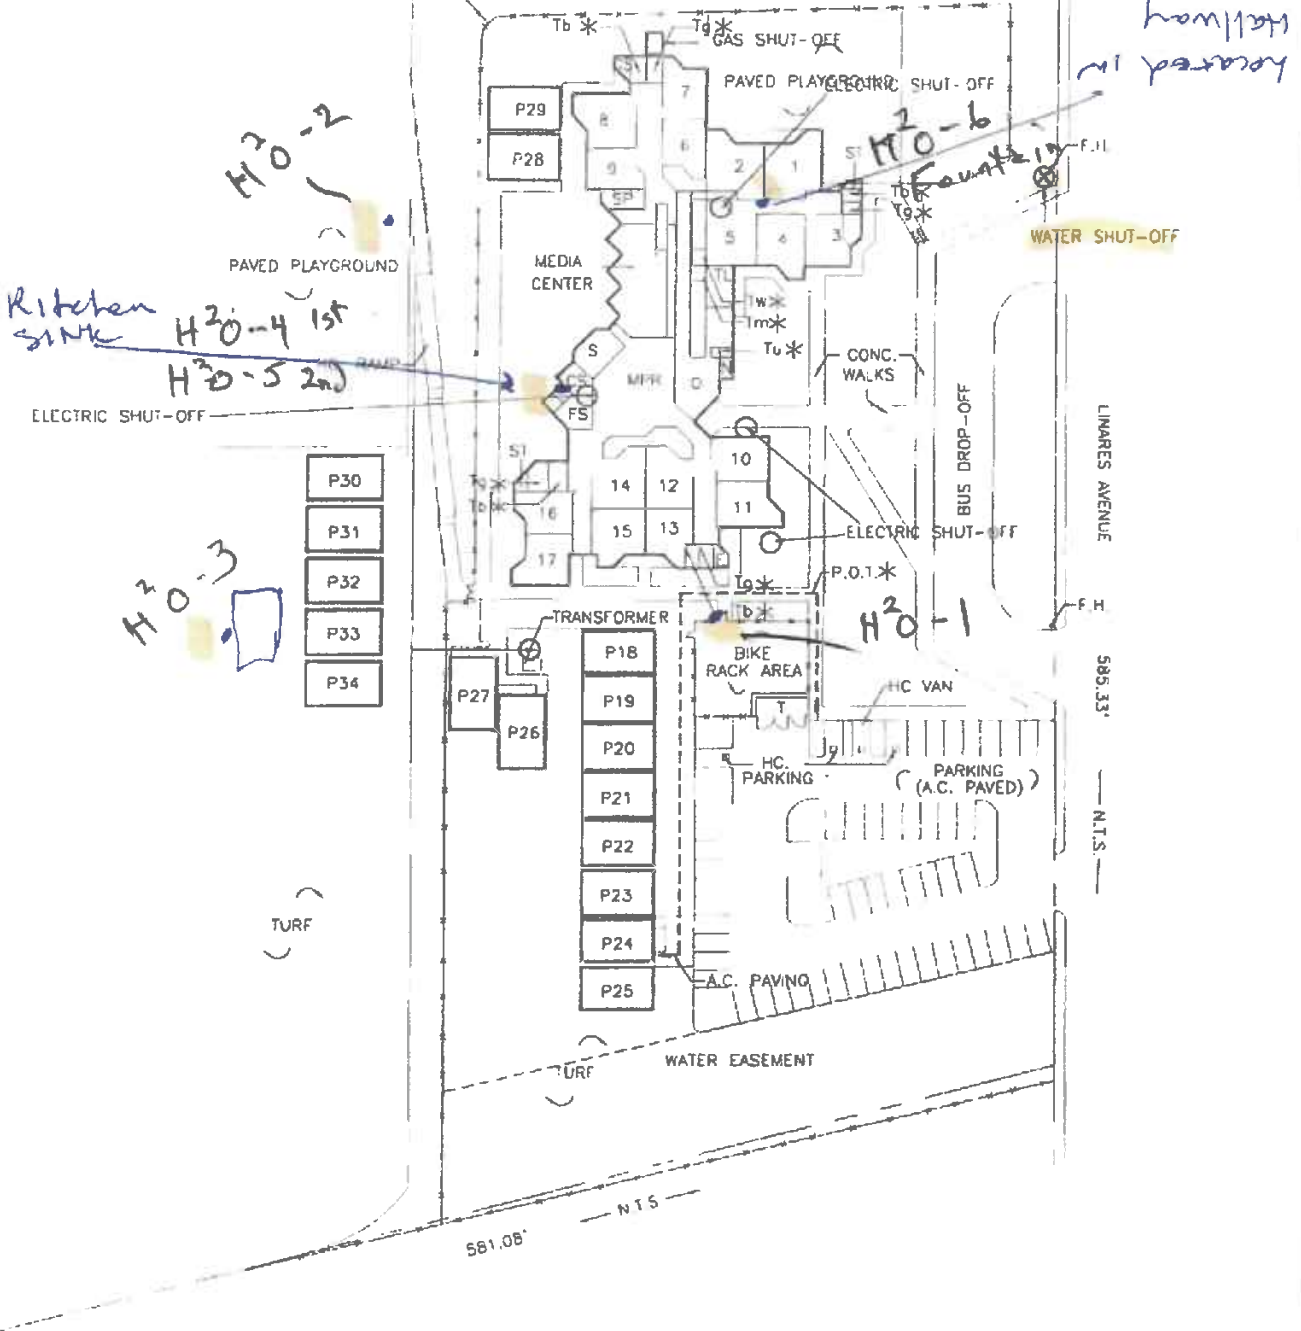

PARKING STALLS 50
 HC STALLS 3
 HC VAN STALLS 1

P E R K I N S
& W I L L

INDIAN HILLS ELEM. SCHOOL
 EXISTING CONDITIONS
 7750 Linnares Ave
 Riverside, CA 92509

Date: 02/05/02
 Project Number: 49814.00
 Scale: 1" = 100' 0"



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 8

Project Name: Misc.

Project Number: Jurupa U.S.D./Peralta Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0820

Received on Ice (Y/N): No

Temp: 21 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8D0820-01	H2O-1 Kitchen Sink 1st Draw	Water	04/07/18 10:31	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0820-02	H2O-2 Kitchen Sink 2nd Draw	Water	04/07/18 10:33	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0820-03	H2O-3 Ext Research Ctr "C" "L"	Water	04/07/18 10:38	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0820-04	H2O-4 Fountain Between B-4 & B-5	Water	04/07/18 10:43	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0820-05	H2O-5 Between RR's At D-11	Water	04/07/18 10:48	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0820-06	H2O-6 Room 22 Fountain	Water	04/07/18 10:54	Michael Cohn	04/09/18 08:25	Sarah Geiger

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 2 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Peralta Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0820

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0820-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 Kitchen Sink 1st Draw	Water	04/07/18 10:31	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:10	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 3 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Peralta Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0820

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0820-02

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-2 Kitchen Sink 2nd Draw	Water	04/07/18 10:33	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:11	MEL	

mailing
P.O Box 432
Riverside. CA 92502-0432

location
6100 Quail Valley Court
Riverside. CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 4 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Peralta Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0820

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0820-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Ext Research Ctr "C" "L"	Water	04/07/18 10:38	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:13	MEL	

mailing
 P.O Box 432
 Riverside. CA 92502-0432

location
 6100 Quail Valley Court
 Riverside. CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 5 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Peralta Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0820

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0820-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Fountain Between B-4 & B-5	Water	04/07/18 10:43	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:27	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 6 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Peralta Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0820

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0820-05

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-5 Between RR's At D-11	Water	04/07/18 10:48	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:29	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 7 of 8
Project Name: Misc.
Project Number: Jurupa U.S.D./Peralta Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0820

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0820-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 Room 22 Fountain	Water	04/07/18 10:54	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:30	MEL	

mailing
P.O Box 432
Riverside. CA 92502-0432

location
6100 Quail Valley Court
Riverside. CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 8 of 8

Project Name: Misc.

Project Number: Jurupa U.S.D./Peralta Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0820

Received on Ice (Y/N): No

Temp: 21 °C

Notes and Definitions

- ND: Analyte NOT DETECTED at or above the **Method Detection Limit (if MDL is reported)**, otherwise at or above the Reportable Detection Limit (RDL)
- NR: Not Reported
- RDL: Reportable Detection Limit
- MDL: Method Detection Limit
- * / " " : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Cindy A. Waddell

cc:

e-Short_No Alias.rpt


This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119

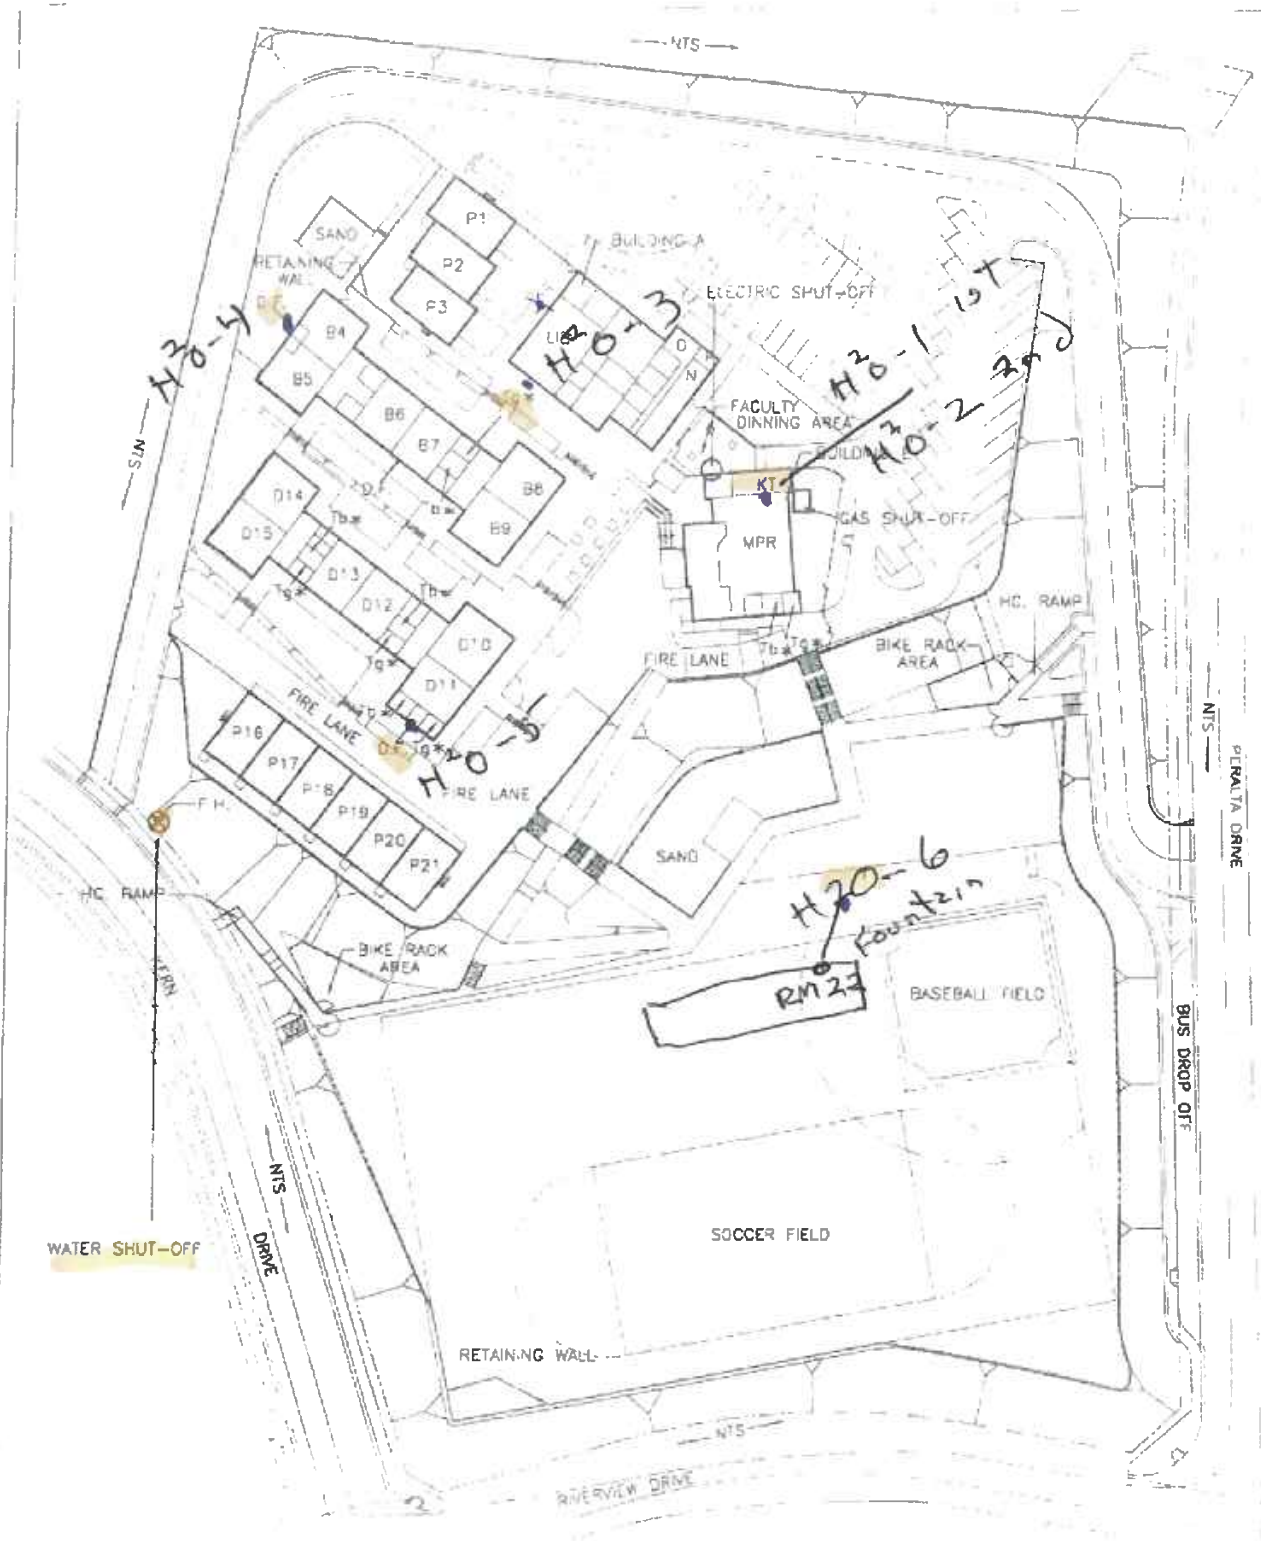

PARKING STALLS 7'
 HC STALLS
 HC VAN STALLS

P E R K I N S
& W I L L
 626 683 9755
 Fax 626 683 5717

PERALTA ELEM. SCHOOL
 EXISTING CONDITIONS
 6450 Peralta Place
 Riv, Ca 92509
 SCHOOL CAMPUS SITE PLANS
 JURUPA UNIFIED SCHOOL DISTRICT

Date: 9/23/98
 Project Number: 49814.00
 Scale: 1" = 100'-0"
 Plot Number: A09



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 8
 Project Name: Misc.
 Project Number: Jurupa USD/Glen Avon
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D1653

Received on Ice (Y/N): No Temp: 20 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8D1653-01	H20-1 Kitchen Sink 1st Draw	Water	04/14/18 06:55	Michael Cohn	04/16/18 09:58	Jacqueline Cohn
B8D1653-02	H20-2 Kitchen Sink 2nd Draw	Water	04/14/18 06:57	Michael Cohn	04/16/18 09:58	Jacqueline Cohn
B8D1653-03	H20-3 Ext Fountain MPR "C" "L"	Water	04/14/18 07:07	Michael Cohn	04/16/18 09:58	Jacqueline Cohn
B8D1653-04	H20-4 Ext Fountain @ Rm D-7	Water	04/14/18 07:10	Michael Cohn	04/16/18 09:58	Jacqueline Cohn
B8D1653-05	H20-5 Ext Fountain @ Bldg E Boys RR	Water	04/14/18 07:13	Michael Cohn	04/16/18 09:58	Jacqueline Cohn
B8D1653-06	H20-6 Ext Fountain @ Bldg H "C" "C"	Water	04/14/18 07:17	Michael Cohn	04/16/18 09:58	Jacqueline Cohn

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 2 of 8
 Project Name: Misc.

Project Number: Jurupa USD/Glen Avon
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D1653**

Received on Ice (Y/N): No Temp: 20 °C

Laboratory Reference Number
B8D1653-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H20-1 Kitchen Sink 1st Draw	Water	04/14/18 06:55	04/16/18 9:58

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/18/18 11:51	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 3 of 8
Project Name: Misc.

Project Number: Jurupa USD/Glen Avon
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D1653

Received on Ice (Y/N): No Temp: 20 °C

Laboratory Reference Number

B8D1653-02

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H20-2 Kitchen Sink 2nd Draw	Water	04/14/18 06:57	04/16/18 9:58

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/18/18 11:54	MEL	

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 4 of 8
 Project Name: Misc.

Project Number: **Jurupa USD/Glen Avon
 Elementary School**

Report Date: 23-Apr-2018

Work Order Number: B8D1653

Received on Ice (Y/N): No Temp: 20 °C

Laboratory Reference Number
B8D1653-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H20-3 Ext Fountain MPR "C" "L"	Water	04/14/18 07:07	04/16/18 9:58

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/18/18 11:57	MEL	

mailing
 P.O Box 482
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 5 of 8
Project Name: Misc.

Project Number: Jurupa USD/Glen Avon
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D1653

Received on Ice (Y/N): No Temp: 20 °C

Laboratory Reference Number
B8D1653-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H20-4 Ext Fountain @ Rm D-7	Water	04/14/18 07:10	04/16/18 9:58

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/18/18 11:59	MEL	

mailing
P.O Box 432
Riverside. CA 92502-0432

location
6100 Quail Valley Court
Riverside. CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 6 of 8
 Project Name: Misc.

Project Number: Jurupa USD/Glen Avon
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D1653

Received on Ice (Y/N): No Temp: 20 °C

Laboratory Reference Number
B8D1653-05

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H20-5 Ext Fountain @ Bldg E Boys RR	Water	04/14/18 07:13	04/16/18 9:58

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/18/18 12:02	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 7 of 8
 Project Name: Misc.

Project Number: Jurupa USD/Glen Avon
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D1653

Received on Ice (Y/N): No Temp: 20 °C

Laboratory Reference Number
B8D1653-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H20-6 Ext Fountain @ Bldg H "C" "C"	Water	04/14/18 07:17	04/16/18 9:58

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/18/18 12:05	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Report Date: 23-Apr-2018

Analytical Report: Page 8 of 8
Project Name: Misc.

Project Number: **Jurupa** USD/Glen Avon
Elementary School

Work Order Number: B8D1653

Received on Ice (Y/N): **No** Temp: 20 °C

Notes and Definitions

- ND:** Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR:** Not Reported
- RDL:** Reportable Detection **Limit**
- MDL:** Method Detection Limit
- * / " : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the **submitted** sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Cindy A. Waddell

cc:

e-Short_No Alias.rpt


This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119

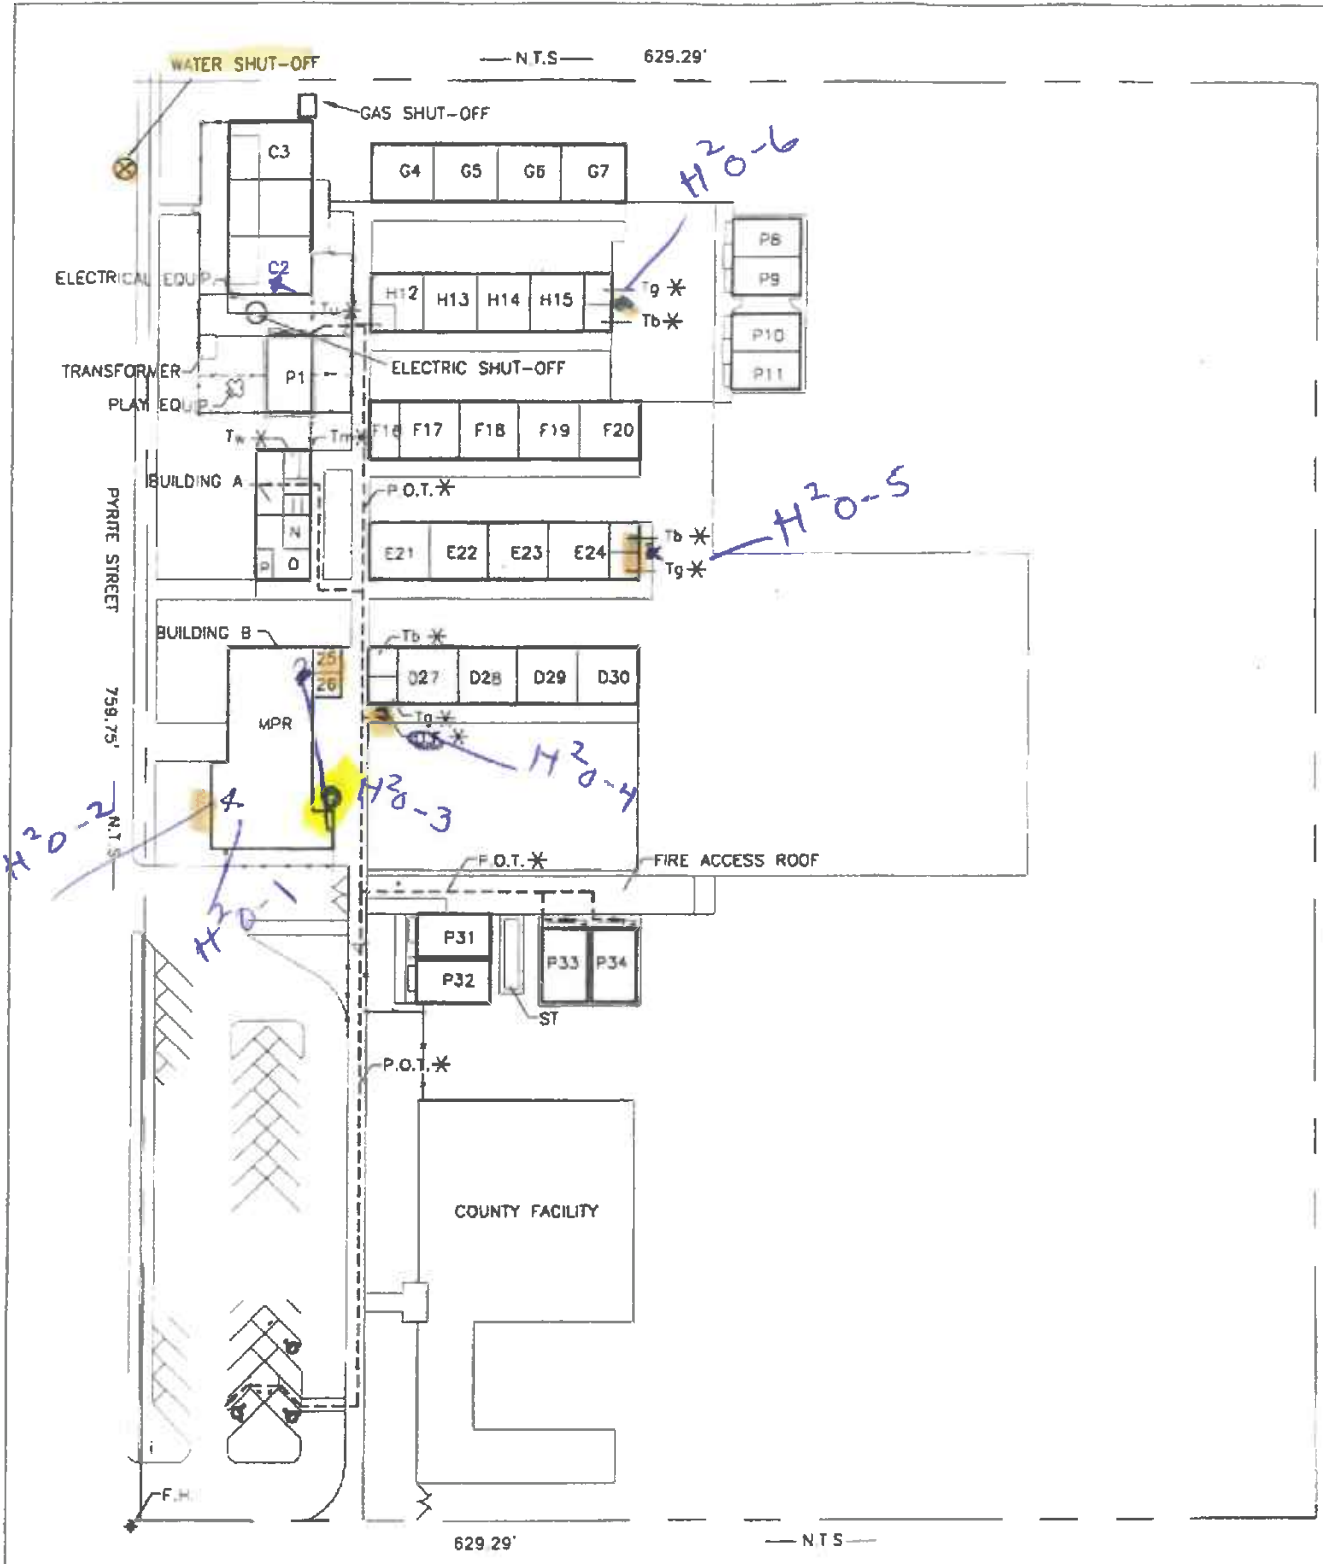

PARKING STALLS 44
 HC STALLS 2
 HC VAN STALLS 1

P E R K I N S
& W I L L

GLEN AVON ELEM. SCHOOL
 EXISTING CONDITIONS
 4382 Pyrite St
 Riverside, Ca 92509

Date: 9/23/98
 Project Number: 49814.00
 Scale: 1" = 100'-0"



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 8
 Project Name: Misc.
 Project Number: Jurupa U.S.D./Ina Arbuckle
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0821

Received on Ice (Y/N): No Temp: 21 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8D0821-01	H2O-1 Kitchen Sink "A" "C"	Water	04/07/18 06:04	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0821-02	H2O-2 Restroom Bldg "B" "C"	Water	04/07/18 06:08	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0821-03	H2O-3 Ext Rm G-6 Fountain "A" "R"	Water	04/07/18 06:16	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0821-04	H2O-4 Room P-35 1st Draw	Water	04/07/18 06:22	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0821-05	H2O-5 Room P-35 2nd Draw	Water	04/07/18 06:25	Michael Cohn	04/09/18 08:25	Sarah Geiger
B8D0821-06	H2O-6 Playground Fountain "C" "R"	Water	04/07/18 06:31	Michael Cohn	04/09/18 08:25	Sarah Geiger

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 2 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Ina Arbuckle
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0821

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0821-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 Kitchen Sink "A" "C"	Water	04/07/18 06:04	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:32	MEL	

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence, for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 3 of 8
 Project Name: Misc.

Project Number: Jurupa U.S.D./Ina Arbutle
 Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0821

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0821-02

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-2 Restroom Bldg "B" "C"	Water	04/07/18 06:08	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:33	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 23-Apr-2018

Analytical Report: Page 4 of 8
 Project Name: Misc.
 Project Number: **Jurupa U.S.D./Ina Arbuckle Elementary School**
 Work Order Number: **B8D0821**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0821-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Ext Rm G-6 Fountain "A" "R"	Water	04/07/18 06:16	04/09/18 8:25

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:35	MEL	

mailing
 P.O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 5 of 8
Project Name: Misc.
Project Number: Jurupa U.S.D./Ina Arbuckle
Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0821**

Received on **Ice** (Y/N): No Temp: 21 °C

Laboratory Reference Number

B8D0821-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Room P-35 1st Draw	Water	04/07/18 06:22	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:37	MEL	

mailing
P.O Box 432
Riverside. CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 6 of 8
 Project Name: Misc.

Project Number: **Jurupa U.S.D./Ina Arbuckle Elementary School**

Report Date: 23-Apr-2018

Work Order Number: B8D0821

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0821-05

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-5 Room P-35 2nd Draw	Water	04/07/18 06:25	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:43	MEL	

mailing
 P.O Box 432
 Riverside. CA 92502-0432

location
 6100 Quail Valley Court
 Riverside. CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 7 of 8
Project Name: Misc.

Project Number: Jurupa U.S.D./Ina Arbuckle
Elementary School

Report Date: 23-Apr-2018

Work Order Number: **B8D0821**

Received on Ice (Y/N): No Temp: 21 °C

Laboratory Reference Number
B8D0821-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 Playground Fountain "C" "R"	Water	04/07/18 06:31	04/09/18 8:25

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/17/18 12:44	MEL	

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 8 of 8
Project Name: Misc.
Project Number: Jurupa U.S.D./Ina Arbuckle
Elementary School

Report Date: 23-Apr-2018

Work Order Number: B8D0821

Received on Ice (Y/N): No Temp: 21 °C

Notes and Definitions

- ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR: Not Reported
- RDL: Reportable Detection Limit
- MDL: Method Detection Limit
- * / " : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Cindy A. Waddell

cc:

e-Short_No Alias.rpt

This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119




BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 1 of 1
Project Name: Misc.
Project Number: Jurupa U.S.D./Ina Arbutckle Elementary School
Work Order Number: B8D0821

Report Date: 23-Apr-2018

Received on Ice (Y/N): No Temp: 21 °C



BABCOCK
Environmental Laboratories

6100 Quail Valley Court Riverside, CA 92507
(951) 653-3351 - FAX (951) 653-1662
www.babcocklabs.com

Chain of Custody & Sample Information Record

Client: AAA Lead Consultants and Inspections, Inc. Contact: Michael P. Cohn Tax No. Additional Reporting Requests
Phone No: 951-582-9071 Email: aaalead@sbcglobal.net Include CC Data Package: Yes No
Project Name: Jurupa Unified School District Turn Around Time: Routine 72-Hour Rush 48-Hour Rush 24 Hour Rush FAX Results: Yes No
Project Location: Ina Arbutckle Elementary School *Lab TAT Approval: By: *Additional Charges Apply: (include Source Number in Notes) Critical Results: Yes No
State EDT: Yes No

Sample Information	Date	Time	# of Containers & Preservatives						Total # of Containers	Sample Type	Analysis Requested	Matrix	Notes
			Unpreserved	HCl	HNO ₃	Na ₂ S ₂ O ₈	NaOH	NaOH/Zn Acetate					
H2O-1 Kitchen Sink "A" "C"	4/7/18	06:04							1			DW	
H2O-2 Restroom Bldg "B" "C"	4/7/18	06:08							1			DW	
H2O-3 Ext Rm G-6 Fountain "A" "R"	4/7/18	06:16							1			DW	
H2O-4 Room P-35 1st Draw	4/7/18	06:22							1			DW	
H2O-5 Room P-35 2nd Draw	4/7/18	06:25							1			DW	
H2O-6 Playground Fountain "C" "R"	4/7/18	06:31							1			DW	

Signature / Print Name / Company	Date / Time	Received By (sign)	Print Name / Company
<i>Michael Cohn</i> Michael Cohn / AAA Lead	4/8/18 4:00pm	<i>Seizh Geiger</i>	Seizh Geiger / AAA Lead
<i>Seizh Geiger</i> Seizh Geiger / AAA Lead	4/9/18 8:25	<i>Heather Wilson</i>	Heather Wilson / AAA Lead

(For Lab Use Only) Sample Integrity Upon Receipt/Acceptance Criteria

Sample (s) Substantive on Ice?	Yes (TIC) / No	Sample meets laboratory acceptance criteria?	Yes / No
Container (s) Intact?	Yes / No / NA	Permission to continue:	Yes / No
Sample (s) Filled?	Yes / No	Deviation/Notes: <i>OK Temp 21°C</i>	
Temperature	21°C / Cooler Blank	Signature/Date: <i>APR 24 2018</i>	


Lab No: **B8D0821NGU**
Logged in By/Date: **APR 09 2018**
Page: **1** of **1**
11-305

mailing
P.O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119

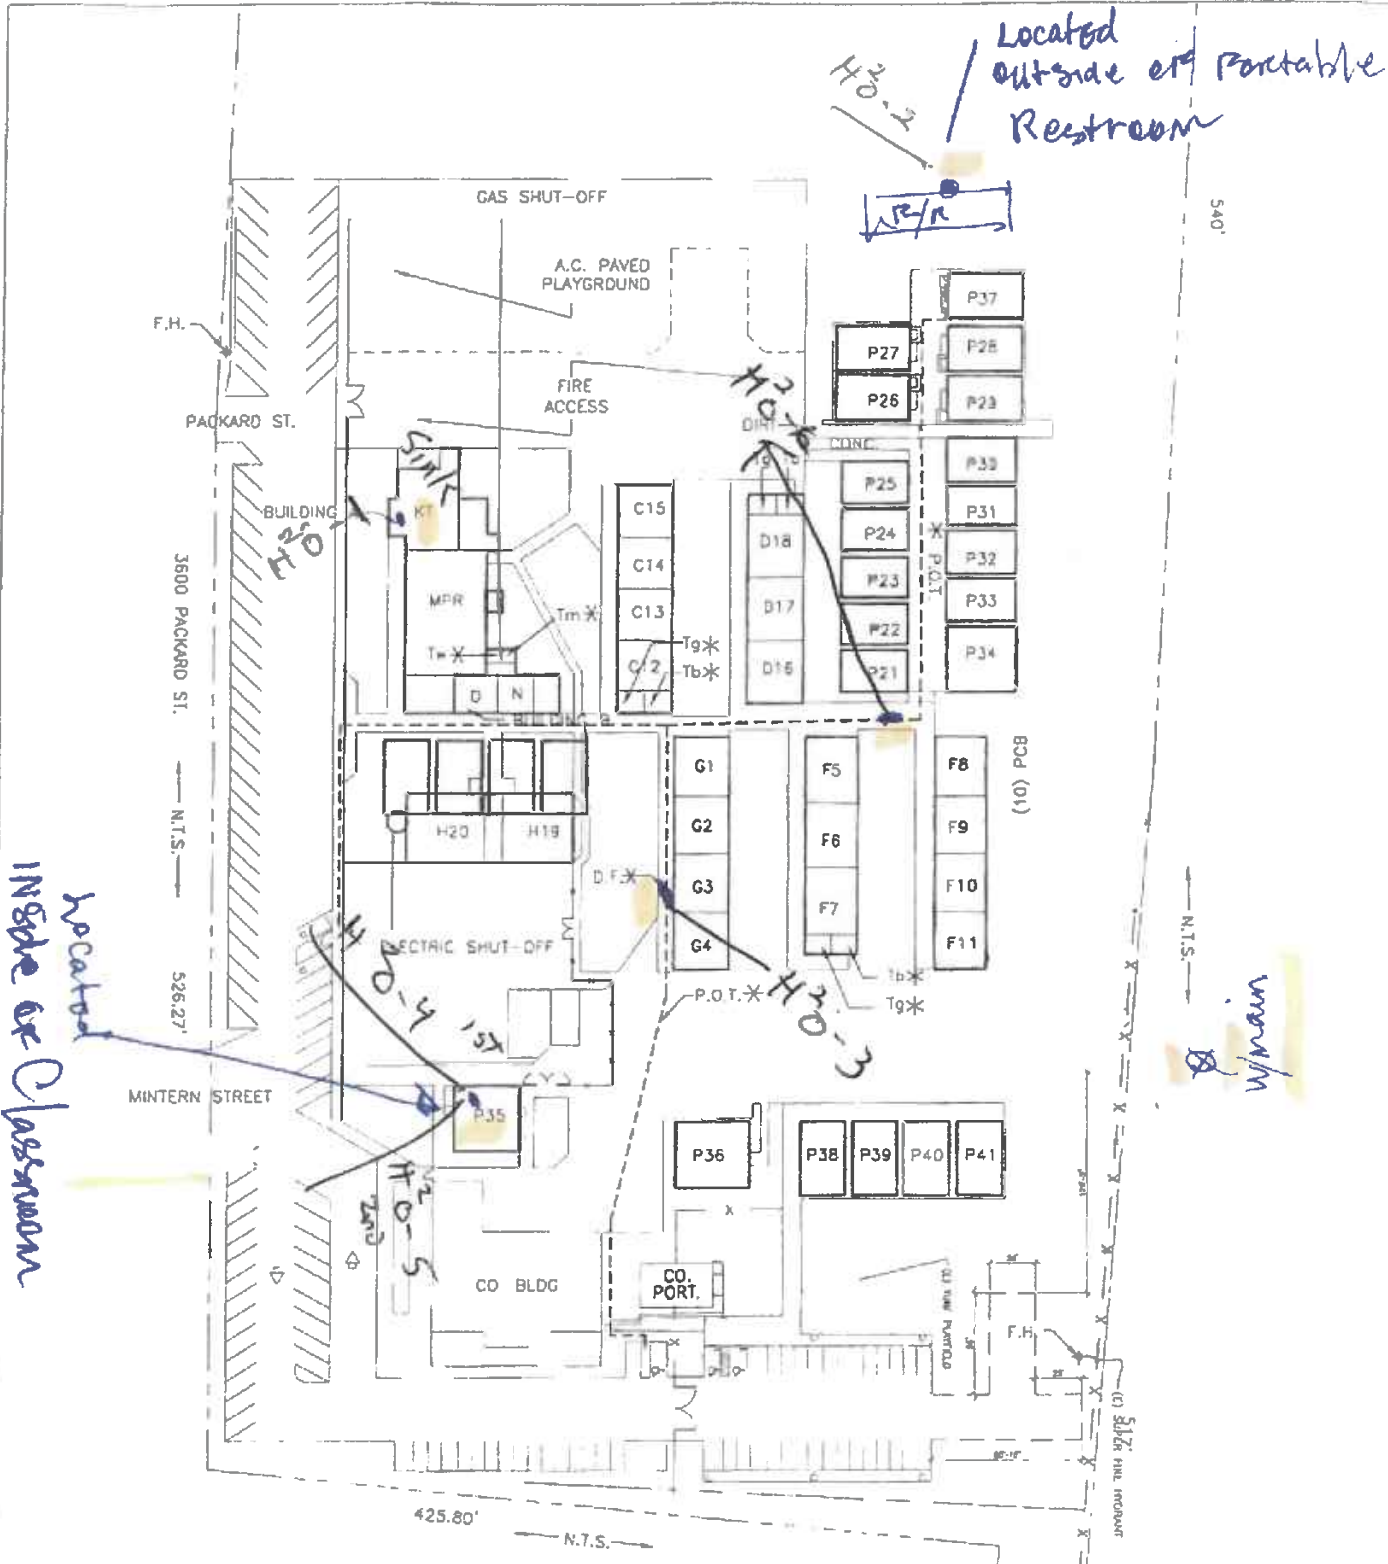

located inside of Classroom

located outside of portable Restroom



PARKING STALLS 115
 HC STALLS 5
 HC VAN STALLS 1

P E R K I N S
& W I L L

INA ARBUCKLE ELEM. SCHOOL
 EXISTING CONDITIONS
 3600 Packard Ave
 Riv, Ca 92509

Date: 02/05/02
 Project Number: 49814.00
 Scale: 1" = 100'-0"

State of California Department of Public Health

Lead-Related Construction Certificate

Certificate Type

Expiration Date



Inspector/Assessor

05/27/2018

Supervisor

05/27/2018

Project Designer

05/27/2018

Project Monitor

05/27/2018

Michael P. Cohn

ID #: 437