



AAA LEAD Consultants and Inspections, Inc.
Consulting - Inspections - Risk Assessment - Project Monitoring
STATE CERTIFIED / INSURED

©

LEAD IN WATER REPORT

FOR

**JURUPA UNIFIED SCHOOL DISTRICT
4740 PEDLEY ROAD
JURUPA VALLEY, CA 92509**

Samples Drawn At

Troth Street Elementary School
Rustic Lane Elementary School
West Riverside Elementary School
Mira Loma Middle School
Van Buren Elementary School

LEAD IN WATER REPORT


REPORT NUMBER: H²O-032418

INSPECTION FOR: Jurupa Unified School District
4740 Pedley Road
Jurupa Valley, Ca 92509

PERFORMED AT: Troth Street Elementary
Rustic Lane Elementary
West Riverside Elementary School
Mira Loma Middle School
Van Buren Elementary School

SAMPLE DATE: March 24, 2018

ACTION LEVEL: 15 parts per billion

SIGNED  DATE April 10, 2018
Michael P. Cohn
DPH #437

This inspection/ sampling was conducted in conformance with American Water Works Association Guidelines for water sampling. AAA Lead Consultants and Inspections, Inc. utilized state-of-art practices and techniques in accordance with regulatory standards while performing this inspection. AAA Lead Consultants and Inspections, Inc. evaluation of the relative risk of exposure to lead identified during this inspection is based on conditions observed at the time inspection. AAA Lead Consultants and Inspections, Inc. cannot be responsible for changing conditions that may alter the relative exposure risk or for changes in accepted methodology.

**LEAD IN WATER REPORT
JURUPA UNIFIED SCHOOL DISTRICT
4740 PEDLEY ROAD
JURUPA VALLEY, CA 92509**

1.0 INTRODUCTION

This report presents the results of AAA LEAD Consultants and Inspections lead in water sampling for the five school sites in the Jurupa Unified School District. AAA LEAD Consultants and Inspections, Inc. collected six water samples from each of the school sites including a second draw from one faucet at each site. This document is prepared for the sole use of Jurupa Unified School District, and any regulatory agencies that are directly involved in this project. No other party should rely on the information contained herein without prior written consent of Jurupa Unified School District. The scope of services and results are presented below.

2.0 SCOPE OF WORK

The purpose of this analysis was to identify and assess the presence of lead in water at each of the school campuses and if present, determine the cause and make recommendations to permanently remove the source of contamination.

On March 24, 2018 AAA Lead Consultants and Inspections obtained six water samples from each school site including kitchen sinks and drinking fountains. None of the sinks or fountains had been used since the previous day. A first and second draw was taken from a sink or fountain at each site followed by a first draw at four other locations on each campus.

3.0 PROPERTY DESCRIPTION

Each school site was unique in age and size. Most campuses had a cafeteria or food service area where some first and second draws were taken. At some schools a first and second draw were taken from high traffic fountains.

4.0 INSPECTOR'S QUALIFICATIONS

Mr. Michael Cohn of AAA LEAD Consultants and Inspections performed the water collection at the site using sterile collection containers with HNO₃ (nitric acid as a preservative) to obtain the water samples. Mr. Cohn has taken water sampling classes offered by the American Water Works Association. Mr. Cohn is certified by the California State Department of Health Services as an Inspector for Lead Based Paint, Project Monitoring, Project Supervision and Project Design.

5.0 METHOD OF TESTING

The samples were drawn into two pint water collection bottles and were sealed. The samples were taken to a State of California Department of Health Services accredited Laboratory for water analysis by EPA approved method 200.8. "Standard Methods for the Examination of Water and Wastewater 1992, 18th Edition", published by the American Public Health Association.

6.0 SUMMARY OF RESULTS

Four of the five schools results were non-detect for the presence of lead in water. One of the schools, Rustic Lane Elementary School, had two fountains with detectable levels of lead. The results of these two fountains are: sample H²O-1, located in Room G-19 with a result of 5.2ppb and sample H²O-2, located on the exterior fountain of Building D between Rooms 12 and 13 with a result of 5.2ppb. Both of these samples were less than the Federal Standard for Lead in Drinking Water which is 15 parts per billion.

7.0 CONCLUSIONS

The first two samples taken at Rustic Lane Elementary School with an identifiable amount of lead indicate the fixtures may cause lead to leach into the water after setting for a period of time. Although the detectable levels of lead are approximately one third of the Federal Standard for Lead in Drinking Water it is our recommendation these faucets should be replaced with new fixtures which do not contain lead.

8.0 REPORT LIMITATIONS

AAA LEAD Consultants and Inspections planned, developed and implemented this water sampling based on AAA LEAD Consultants and Inspections previous experience in performing lead in water sampling. This drawing of samples was conducted in conformance with American Water Works Association guidelines. AAA LEAD Consultants and Inspections utilized state-of-the-art practices and techniques in accordance with regulatory standards while performing this sampling. A copy of personnel certifications has been provided for your review. AAA LEAD Consultants and Inspections evaluation of the relative risk of exposure to lead identified during this sampling is based on laboratory analysis. AAA LEAD Consultants and Inspections cannot be responsible for changing conditions that may alter the relative exposure risk or for future changes in accepted methodology.

State of California Department of Public Health

Lead-Related
Construction
Certificate

Certificate

Expiration

Type

Date



Inspector/Assessor	05/27/2018
Supervisor	05/27/2018
Project Designer	05/27/2018
Project Monitor	05/27/2018



Michael P. Cohn

ID #: 437



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 8
 Project Name: Misc.
 Project Number: Jurupa U. S./Troth Street
 Elementary School

Report Date: 09-Apr-2018

Work Order Number: B8C2561

Received on Ice (Y/N): No Temp: 13 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8C2561-01	H2O-1 Kitchen Sink 1st Draw	Water	03/24/18 09:22	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2561-02	H2O-2 Kitchen Sink 2nd Draw	Water	03/24/18 09:24	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2561-03	H2O-3 Bldg G Ext Fountain at Rm 1 & 2	Water	03/24/18 09:27	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2561-04	H2O-4 Playground Fountain	Water	03/24/18 09:32	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2561-05	H2O-5 Building C S/W Fountain	Water	03/24/18 09:37	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2561-06	H2O-6 Room K-18 Fountain	Water	03/24/18 09:41	Michael Cohn	03/26/18 09:20	Michael Cohn

mailing
 P O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 2 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Troth Street
Elementary School

Work Order Number: B8C2561

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2561-01

Sample Description
H2O-1 Kitchen Sink 1st Draw

Matrix
Water

Sampled Date/Time
03/24/18 09:22

Received Date/Time
03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	03/30/18 15:00	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951.653.3351
F 951.653.1682
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA60102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 3 of 8
Project Name: Misc.

Report Date: 09-Apr-2018

Project Number: Jurupa U. S./Troth Street
Elementary School

Work Order Number: **B8C2561**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2561-02

Sample Description

H2O-2 Kitchen Sink 2nd Draw

Matrix
Water

Sampled Date/Time
03/24/18 09:24

Received Date/Time
03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	03/30/18 15:01	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA60102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 4 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Troth Street
Elementary School

Report Date: 09-Apr-2018

Work Order Number: B8C2561

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2561-03

Sample Description

H2O-3 Bldg G Ext Fountain at Rm 1 & 2

Matrix
Water

Sampled Date/Time
03/24/18 09:27

Received Date/Time
03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	03/30/18 15:03	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 160 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 5 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Troth Street
Elementary School

Report Date: 09-Apr-2018

Work Order Number: **B8C2561**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2561-04

Sample Description

H2O-4 Playground Fountain

Matrix

Water

Sampled Date/Time

03/24/18 09:32

Received Date/Time

03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	03/30/18 15:04	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LAUSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 6 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Troth Street
Elementary School
Work Order Number: **B8C2561**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2561-05

Sample Description
H2O-5 Building C S/W Fountain

Matrix
Water

Sampled Date/Time
03/24/18 09:37

Received Date/Time
03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids Lead	ND	5.0	ug/L	EPA 200.8	03/30/18 15:05	MEL	

mailing
P.O. Box 132
Riverside, CA 92502-0132

location
6100 Quail Valley Court
Riverside, CA 92507-0704

F 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2688
EPA No. CA00402
NELAP No. GR4035
LAC SB No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 7 of 8
 Project Name: Misc.

Report Date: 09-Apr-2018

Project Number: Jurupa U. S./Troth Street
 Elementary School

Work Order Number: **B8C2561**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2561-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 Room K-18 Fountain	Water	03/24/18 09:41	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	03/30/18 15:06	MEL	

mailing
 P.O. Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 09-Apr-2018

Analytical Report: Page 8 of 8
 Project Name: Misc.
 Project Number: Jurupa U. S./Troth Street
 Elementary School
 Work Order Number: **B8C2561**
 Received on Ice (Y/N): No Temp: 13 °C

Notes and Definitions

- ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR: Not Reported
- RDL: Reportable Detection Limit
- MDL: Method Detection Limit
- * / * : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Albert Trujillo For Cindy A. Waddell

cc:

e-Short_No Alias rpt

This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
 P O Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 1 of 1
Project Name: Misc.
Project Number: Jurupa U. S./Troth Street
Elementary School
Work Order Number: B8C2561

Received on Ice (Y/N): No Temp: 13 °C


Chain of Custody & Sample Information Record form containing a table with columns for Date, Time, Sample Location, and various chemical analysis checkboxes. Includes handwritten signatures and dates.

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 655 8351
F 951 653 1662
www.babcock-labs.com

CA ELAP No 2698
EPA No. CA00102
NELAP No. OR4035
IACSD No. 10119

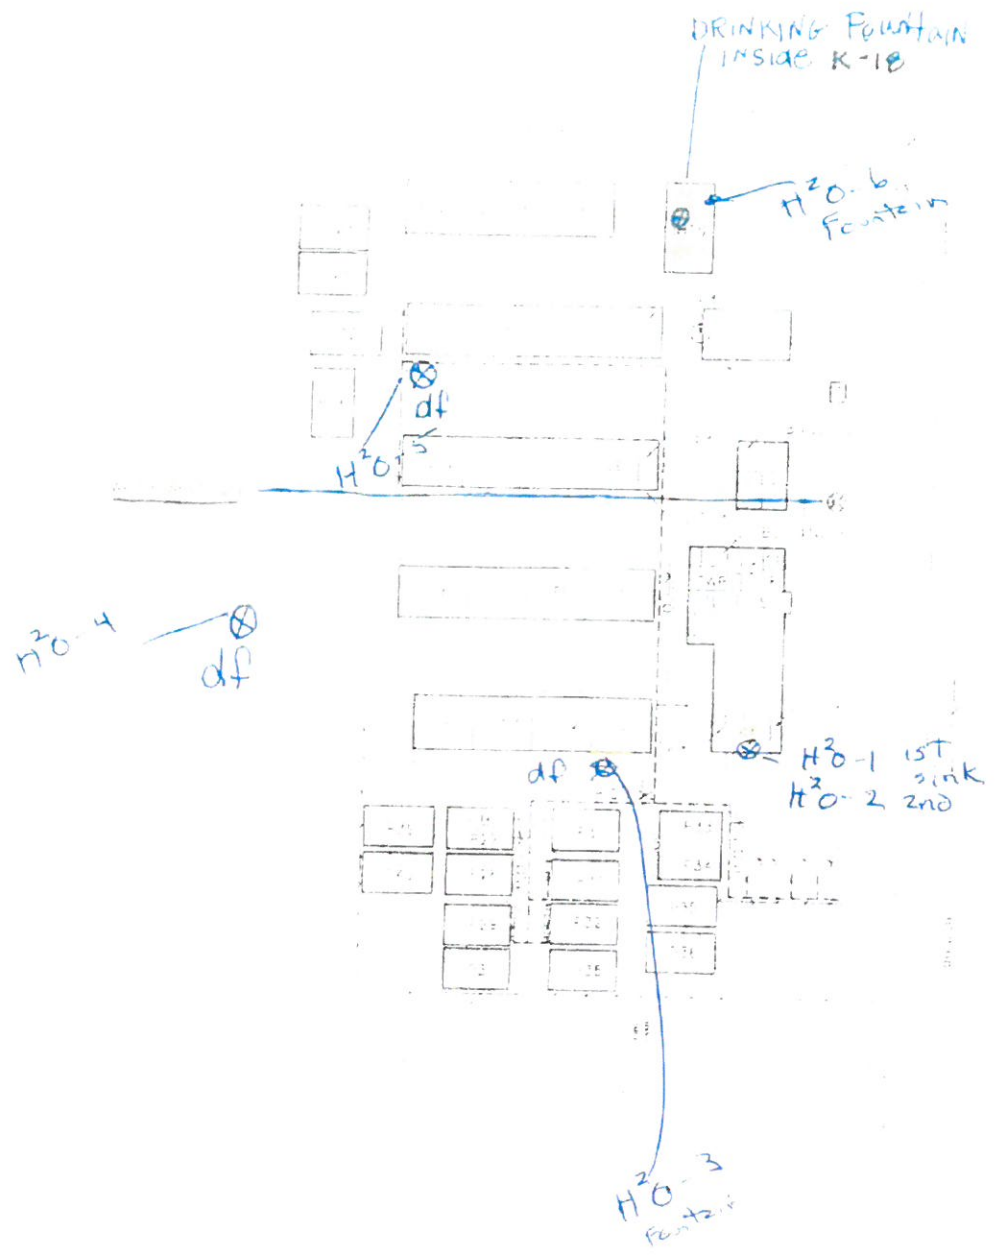



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 09-Apr-2018

Analytical Report: Page 1 of 8
 Project Name: Misc.
 Project Number: Jurupa U. S./Rustic Lane
 Elementary School
 Work Order Number: **B8C2562**
 Received on Ice (Y/N): No Temp: 13 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8C2562-01	H2O-1 Room G-19 Fountain	Water	03/24/18 06:32	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2562-02	H2O-2 Ext Fountain Bldg D Rm 12-13	Water	03/24/18 06:36	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2562-03	H2O-3 Outside Restrooms	Water	03/24/18 06:40	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2562-04	H2O-4 Playground Fountain	Water	03/24/18 06:45	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2562-05	H2O-5 MPR Kitchen Sink 1st Draw	Water	03/24/18 06:59	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2562-06	H2O-6 MPR Kitchen Sink 2nd Draw	Water	03/24/18 06:55	Michael Cohn	03/26/18 09:20	Michael Cohn

Mailing
 P.O. Box 432
 Riverside, CA 92502-0432

Location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LAUSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 2 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Rustic Lane
Elementary School

Report Date: 09-Apr-2018

Work Order Number: **B8C2562**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2562-01

Sample Description
H2O-1 Room G-19 Fountain

Matrix
Water

Sampled Date/Time
03/24/18 06:32

Received Date/Time
03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	5.2	5.0	ug/L	EPA 200.8	03/29/18 13:28	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 3 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Rustic Lane
Elementary School

Report Date: 09-Apr-2018

Work Order Number: **B8C2562**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2562-02

Sample Description

H2O-2 Ext Fountain Bldg D Rm 12-13

Matrix

Water

Sampled Date/Time

03/24/18 06:36

Received Date/Time

03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	5.0	5.0	ug/L	EPA 200.8	03/29/18 13:31	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LAUSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 4 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Rustic Lane
Elementary School
Work Order Number: **B8C2562**
Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2562-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Outside Restrooms	Water	03/24/18 06:40	03/26/18 9:20

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids Lead	ND	5.0	ug/L	EPA 200.8	03/29/18 13:34	MEL	

mailing
P.O. Box 482
Riverside, CA 92502-0482

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1682
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10419



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 5 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Rustic Lane
Elementary School
Work Order Number: **B8C2562**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2562-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Playground Fountain	Water	03/24/18 06:45	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	03/29/18 13:36	MEL	

mailing
P O Box 482
Riverside, CA 92502-0482

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 7 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Rustic Lane
Elementary School
Work Order Number: **B8C2562**
Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2562-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 MPR Kitchen Sink 2nd Draw	Water	03/24/18 06:55	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids Lead	ND	5.0	ug/L	EPA 200.8	03/29/18 13:41	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951.653.3351
F 951.653.1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. 0R4035
LAUSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Report Date: 09-Apr-2018

Analytical Report: Page 8 of 8

Project Name: Misc.

Project Number: Jurupa U. S./Rustic Lane
Elementary School

Work Order Number: **B8C2562**

Received on Ice (Y/N): No Temp: 13 °C

Notes and Definitions

- ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR: Not Reported
- RDL: Reportable Detection Limit
- MDL: Method Detection Limit
- * / "": NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Albert Trujillo For Cindy A. Waddell

cc:

e-Short_No Alias rpt

This report applies only to the sample(s) analyzed. An analytical protection to clients, the public, and Babcock Laboratories, Inc. This report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of the report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used in whole or in part in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analysis, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 658 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR1035
TACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 09-Apr-2018

Analytical Report: Page 1 of 1
 Project Name: Misc.
 Project Number: Jurupa U. S./Rustic Lane
 Elementary School
 Work Order Number: **B8C2562**

Received on Ice (Y/N): No Temp: 13 °C

Chain of Custody & Sample Information Record

LABORATORY: 6100 Quail Valley Court, Riverside, CA 92507
 Telephone: (951) 653-3351 Fax: (951) 653-1362
 Email: babcocklabs.com

Client: AAA Lead Consultants and Inspections, Inc. Contact: Michael P. Cohn Fax: (951) 653-3351
 Email: mcohn@aaalead.com

Project Name: Jurupa Unified School District
 Project Location: Rustic Lane Elementary School

Project Description: Lead Testing

Client Representative: Michael P. Cohn
 Date: 3/24/18 Time: 06:32

Analyst: [Signature]
 Date: 3/24/18 Time: 06:36

Analyst: [Signature]
 Date: 3/24/18 Time: 06:40

Analyst: [Signature]
 Date: 3/24/18 Time: 06:45

Analyst: [Signature]
 Date: 3/24/18 Time: 06:59

Analyst: [Signature]
 Date: 3/24/18 Time: 06:55

Sample ID	Date	Time	Preservatives						Total # of Containers	By			Analysis Requester	Matrix	Notes
			Unpreservac	H2SO4	HCl	HNO3	Na2S2O8	NaOH		NaOH/Zn Acetate	NH4Cl	MCAA			
H2O-1 Room G-19 Fountain	3/24/18	06:32							1				[Signature]	DW	
H2O-2 Full Courtroom Bldg D-Pan 12-13	3/24/18	06:36							1				[Signature]	DW	
H2O-3 Outside Restroom 5	3/24/18	06:40							1				[Signature]	DW	
H2O-4 Playground Fountain	3/24/18	06:45							1				[Signature]	DW	
H2O-5 EPR Kitchen Sink - 1st Day	3/24/18	06:59							1				[Signature]	DW	
H2O-6 EPR Kitchen Sink - 2nd Day	3/24/18	06:55							1				[Signature]	DW	

Client Representative: [Signature] Date: 3/24/18 Time: 06:32
 Laboratory: [Signature] Date: 3/24/18 Time: 06:36
 Laboratory: [Signature] Date: 3/24/18 Time: 06:40
 Laboratory: [Signature] Date: 3/24/18 Time: 06:45
 Laboratory: [Signature] Date: 3/24/18 Time: 06:59
 Laboratory: [Signature] Date: 3/24/18 Time: 06:55

Handwritten notes: 2018 (951) 653-3351

Handwritten notes: BOC 2562 NGU
 Date: 4/9/18

mailing
 P O Box 432
 Riverside, CA 92502-0432

Location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No 2698
 EPA No CA00102
 NELAP No OR1035
 LACSD No 10119

DETAILED

drinking fountain
outside of restrooms

H₂O-3

RAIN

COMPACTED
L.C. SURFACE

CONC. SIDEWALK

ELEC
DIS

P36 P37 P38

P30 P29 P28 P27

P35 P34

P33 P32

P26 P25 P24 P23 P22 P21

E18 E17 E16 E15

D14 D13 D12 D11 D10

G20 G19

ELECTRIC SHUT-OFF

6420 PLASTIC CANE

WATER SHUT-OFF

GAS SHUT-OFF

ADJUT.

d.f.
Playground
H₂O-4

H₂O-01

Inside
Classroom
G+19

outside
H₂O-2


BUILDING F

C10 C9 C8

E7 B6 B5

A4 A3 A2 A1
B4 B3 B2 B1

H₂O-5
Kitchen
1st
H₂O-6 2nd



P L K R S
S W I L L

EXISTING CONCRETE

Date: 6/23/88
Project Number: 48814-01
Scale: 1/4" = 1'-0"



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 09-Apr-2018

Analytical Report Page 1 of 8
 Project Name: Misc.
 Project Number: Jurupa U. S./West Riverside
 Elementary School
 Work Order Number: **B8C2556**

Received on Ice (Y/N): No Temp: 13 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8C2556-01	H2O-1 Kitchen Center Sink 1st Draw	Water	03/24/18 07:11	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2556-02	H2O-2 Kitchen Center Sink 2nd Draw	Water	03/24/18 07:13	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2556-03	H2O-3 Room G-25 Fountain	Water	03/24/18 07:19	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2556-04	H2O-4 Playground Fountain	Water	03/24/18 07:25	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2556-05	H2O-5 Fountain at Restrooms	Water	03/24/18 07:30	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2556-06	H2O-6 Ext A-1 / A-2 Fountain	Water	03/24/18 07:35	Michael Cohn	03/26/18 09:20	Michael Cohn

mailing
 P.O. Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 4351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 09-Apr-2018

Analytical Report: Page 2 of 8
 Project Name: Misc.
 Project Number: Jurupa U. S./West Riverside
 Elementary School
 Work Order Number: **B8C2556**
 Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2556-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 Kitchen Center Sink 1st Draw	Water	03/24/18 07:11	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/03/18 13:00	MEL	

mailing
 P.O. Box 432
 Riverside, CA 92502-0432

location
 6100 Quad Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 3 of 8
Project Name: Misc.

Project Number: Jurupa U. S./West Riverside
Elementary School

Report Date: 09-Apr-2018

Work Order Number: **B8C2556**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2556-02

Sample Description

H2O-2 Kitchen Center Sink 2nd Draw

Matrix

Water

Sampled Date/Time

03/24/18 07:13

Received Date/Time

03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/03/18 13:02	MEL	

mailing
P.O. Box 452
Riverside, CA 92502-0452

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951-653-3351
F 951-653-1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report Page 4 of 8
 Project Name: Misc.

Project Number: Jurupa U. S./West Riverside
 Elementary School

Report Date: 09-Apr-2018

Work Order Number: **B8C2556**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2556-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Room G-25 Fountain	Water	03/24/18 07:19	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/03/18 13:05	MEL	

mailing
 P.O. Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 4351
 F 951 653 4662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 5 of 8
Project Name: Misc.
Project Number: Jurupa U. S./West Riverside
Elementary School
Work Order Number: **B8C2556**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2556-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Playground Fountain	Water	03/24/18 07:25	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/03/18 13:07	MEL	

Mailing
P.O. Box 432
Riverside, CA 92502-0432

Location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACS0 No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 6 of 8
Project Name: Misc.
Project Number: Jurupa U. S./West Riverside
Elementary School
Work Order Number: **B8C2556**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2556-05

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-5 Fountain at Restrooms	Water	03/24/18 07:30	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/03/18 13:10	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951.653.3351
F 951.653.1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 7 of 8
Project Name: Misc.
Project Number: Jurupa U. S /West Riverside
Elementary School
Work Order Number: B8C2556

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2556-06

Sample Description Matrix Sampled Date/Time Received Date/Time
H2O-6 Ext A-1 / A-2 Fountain Water 03/24/18 07:35 03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids Lead	ND	5.0	ug/L	EPA 200.8	04/03/18 13:13	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Report Date: 09-Apr-2018

Analytical Report: Page 8 of 8
Project Name: Misc.

Project Number: Jurupa U. S /West Riverside
Elementary School

Work Order Number: **B8C2556**

Received on Ice (Y/N): No Temp: 13 °C

Notes and Definitions

- ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR: Not Reported
- RDL: Reportable Detection Limit
- MDL: Method Detection Limit
- * / ** : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Albert Trujillo For Cindy A. Waddell

cc:

e-Short_No Alias.rpt

This report applies only to the sample(s) analyzed. As a matter of protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10149



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 1
 Project Name: Misc.

Project Number: Jurupa U. S./West Riverside
 Elementary School

Report Date: 09-Apr-2018

Work Order Number: **B8C2556**

Received on Ice (Y/N): No Temp: 13 °C



BABCOCK
 LABORATORIES, INC.

6100 Quail Valley Court Riverside, CA 92504
 (951) 653-3351 • FAX: (951) 653-1662
 www.babcocklabs.com

Chain of Custody & Sample Information Record

Client: AAA Lead Consultants and Inspections, Inc.
 Project: 1307 West Sixth Street
 Request Location: Jurupa Unified School District
 Request Location: West Riverside Elementary School

Contact: Michael F. Cohn
 Email: mcohn@babcocklabs.com
 Turn Around Time: Routine 72 Hour Rush 18 Hour Rush 24 Hour Rush

Additional Reporting Request:
 Lead PCBs Dioxin PCBs
 PCBs Dioxin PCBs
 PCBs Dioxin PCBs
 PCBs Dioxin PCBs

Sample ID	Date	Time
H2O-1 Kitchen Center Sink - 1st Draw	3/24/18	07:11
H2O-2 Kitchen Center Sink - 2nd Draw	3/24/18	07:13
H2O-3 Room G-25 Fountain	3/24/18	07:19
H2O-4 Playground Fountain	3/24/18	07:25
H2O-5 Fountain at Restrooms	3/24/18	07:30
H2O-6 Ext A-1 / A-2 Fountain	3/24/18	07:35

Unpreserved	HCl	HNO ₃	Na ₂ S ₂ O ₈	NaOH	NaOH/Zn Acetate	NH ₄ Cl	MTCA	Total # of Containers	Sample Type	Analysis Requested
								1	Routine	
								1	Special	
								1	Special	
								1	Special	
								1	Special	
								1	Special	

Matrix	Notes
DW	
DW	
DW	
DW	
DW	
DW	

Signature: [Signature] Date: 3/24/18
 Printed Name: Michael Cohn
 Title: N/A Lead
 Received By (s): [Signature] Date: 3/24/18
 Printed Name: Company: [Signature]


For more information, please contact your local office or call 951-653-3351.
 Signature: [Signature] Date: 3/24/18
 Printed Name: [Signature]
 Title: [Signature]
 Signature: [Signature] Date: 3/24/18
 Printed Name: [Signature]
 Title: [Signature]

mailing
 P O Box 432
 Riverside, CA 92502-0432

Location
 6100 Quail Valley Court
 Riverside, CA 92507-0701

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119

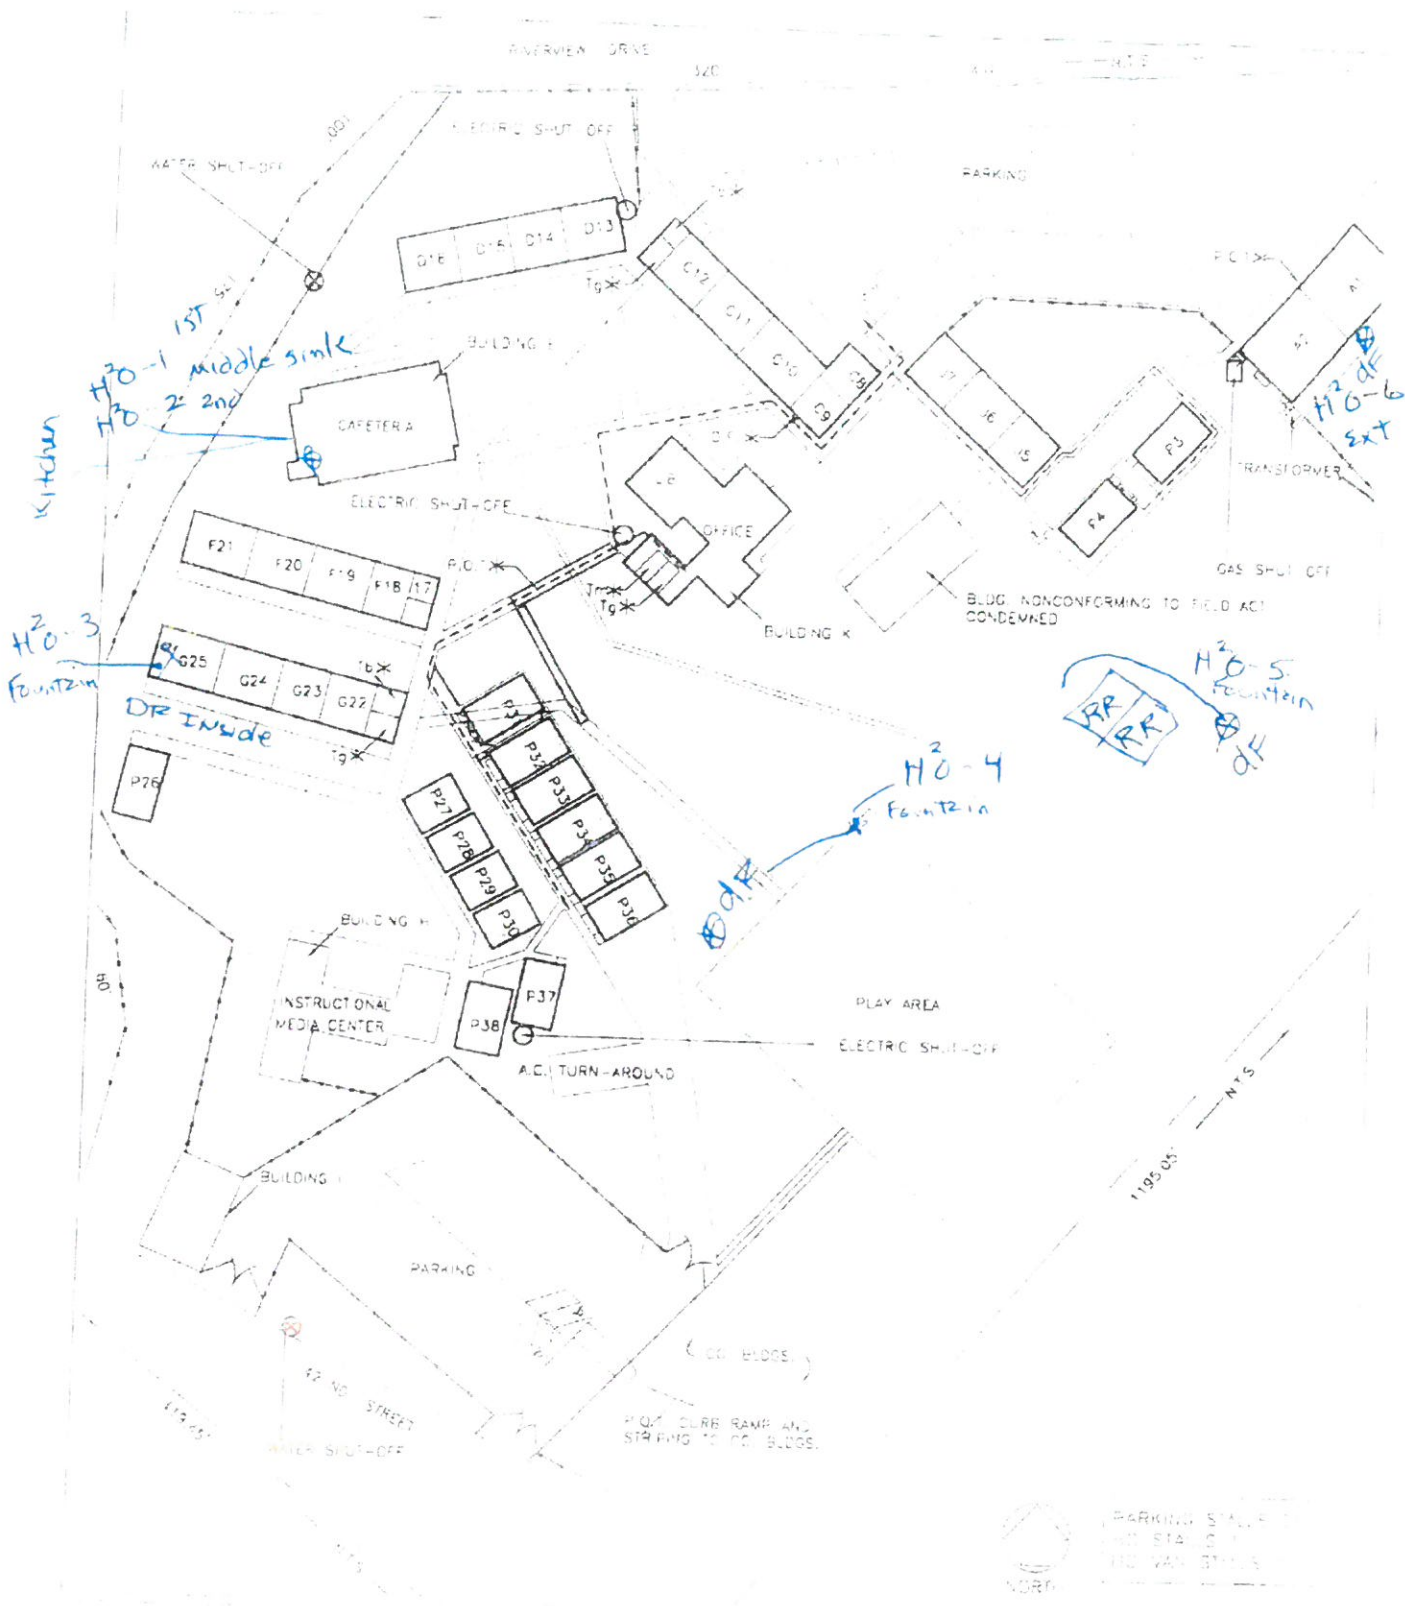

15 12 11 10 9 8
 7 6 5 4 3 2 1
 0 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15

WEST RIVERSIDE ELEM. SCH. COOLING
 EXISTING CONDITIONS
 PROJECT NUMBER: 49874-00
 SCALE: AS SHOWN
 DATE: 9/23/98

Date:	9/23/98
Project Number:	49874-00
Scale:	AS SHOWN
Int. Revision:	1



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 1 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Miral Loma Middle School

Report Date: 09-Apr-2018

Work Order Number: **B8C2557**

Received on Ice (Y/N): No Temp: 13 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8C2557-01	H2O-1 MPR N/W Fountain	Water	03/24/18 08:38	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2557-02	H2O-2 Kitchen Sink 1st Draw	Water	03/24/18 08:44	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2557-03	H2O-3 Kitchen Sink 2nd Draw	Water	03/24/18 08:46	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2557-04	H2O-4 Ext Fountain at Restrooms	Water	03/24/18 08:48	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2557-05	H2O-5 Building G N/W Fountain	Water	03/24/18 08:58	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2557-06	H2O-6 Outside Restrooms	Water	03/24/18 09:03	Michael Cohn	03/26/18 09:20	Michael Cohn

mailing
P O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3354
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 2 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Miral Loma Middle School

Report Date: 09-Apr-2018

Work Order Number: **B8C2557**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2557-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 MPR N/W Fountain	Water	03/24/18 08:38	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 16:53	MEL	

Mailing
P O Box 432
Riverside, CA 92502-0432

Location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1092
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 3 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Miral Loma Middle School

Report Date: 09-Apr-2018

Work Order Number: B8C2557

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2557-02

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-2 Kitchen Sink 1st Draw	Water	03/24/18 08:44	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 16:56	MEL	

mailing
P.O. Box 482
Riverside, CA 92502-0482

location
6100 Quail Valley Court
Riverside, CA 92507-0701

P 951.653.3351
F 951.653.1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. 0R4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 4 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Miral Loma Middle School

Report Date: 09-Apr-2018

Work Order Number: **B8C2557**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2557-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Kitchen Sink 2nd Draw	Water	03/24/18 08:46	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 16:59	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR1035
LAUSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 5 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Miral Loma Middle School

Report Date: 09-Apr-2018

Work Order Number: B8C2557

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2557-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Ext Fountain at Restrooms	Water	03/24/18 08:48	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 17:01	MEL	

Mailing
P.O. Box 482
Riverside, CA 92502-0482

Location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NEJAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 6 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Miral Loma Middle School

Report Date: 09-Apr-2018

Work Order Number: **B8C2557**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2557-05

Sample Description

H2O-5 Building G N/W Fountain

Matrix

Water

Sampled Date/Time

03/24/18 08:58

Received Date/Time

03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 17:04	MEL	

mailing

P.O. Box 432
Riverside, CA 92502-0432

location

6100 Quad Valley Court
Riverside, CA 92507-0704

P 951 653 3351

F 951 653 1662

www.babcocklabs.com

CA ELAP No. 2698

EPA No. CA00102

NEJAP No. OR4035

LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 7 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Miral Loma Middle School

Report Date: 09-Apr-2018

Work Order Number: **B8C2557**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2557-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 Outside Restrooms	Water	03/24/18 09:03	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 17:07	MEL	

Mailing
P.O. Box 432
Riverside, CA 92502-0432

Location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1062
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 8 of 8
 Project Name: Misc.

Report Date: 09-Apr-2018

Project Number: Jurupa U. S./Miral Loma Middle School
 Work Order Number: **B8C2557**
 Received on Ice (Y/N): No Temp: 13 °C

Notes and Definitions

- ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR: Not Reported
- RDL: Reportable Detection Limit
- MDL: Method Detection Limit
- * / ** : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted

Albert Trujillo For Cindy A. Waddell

cc:

e-Short_No Alias.rpt

This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used, in whole or in part, in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analyses, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
 P.O. Box 432
 Riverside, CA 92502-0432

location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882

Analytical Report: Page 1 of 1
 Project Name: Misc.

Report Date: 09-Apr-2018

Project Number: Jurupa U. S./Miral Loma Middle School

Work Order Number: **B8C2557**

Received on Ice (Y/N): No Temp: 13 °C

Chain of Custody & Sample Information Record

Client: AAA Lead Consultants and Inspections, Inc. Contact: Michael P. Cohn Fax No. _____
 Email: aaalead@sbglobal.net
 Project: Jurupa Unified School District Turn Around Time: Routine 72 Hour Rush 48 Hour Rush 24 Hour Rush
 Lab/Anal Approval: _____ By: _____ *Additional Charges Apply

Sample ID	Date	Time	Unpreserved	HCl	HNO ₃	H ₂ SO ₄	NaOH	NaOH/NaNO ₂	NaOH/NaNO ₃	NaOH/NaNO ₂ /NaNO ₃	NaOH/NaNO ₂ /NaNO ₃ /HCl	MCAA	Total # of Containers	Sample Type	Analysis Performed	Matrix	Notes
H2O-1 MPR NW Fountain	3/24/18	08:38	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1	Routine		DW	
H2O-2 Etchen Sink 1st Draw	3/24/18	08:44	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1	Routine		DW	
H2O-3 Etchen Sink 2nd Draw	3/24/18	08:46	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1	Routine		DW	
H2O-4 1st Fountain at Restrooms	3/24/18	08:48	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1	Routine		DW	
H2O-5 Bulking G NW Fountain	3/24/18	08:58	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1	Routine		DW	
H2O-6 Outside Restrooms	3/24/18	09:03	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	1	Routine		DW	

Print Name / Company: _____ Date / Time: _____ Analyzed By (signature): _____ Print Name / Company: _____


Work Order Number: **B8C2557**

mailing
 P O Box 432
 Riverside, CA 92502-0432

location
 8100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
 www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119

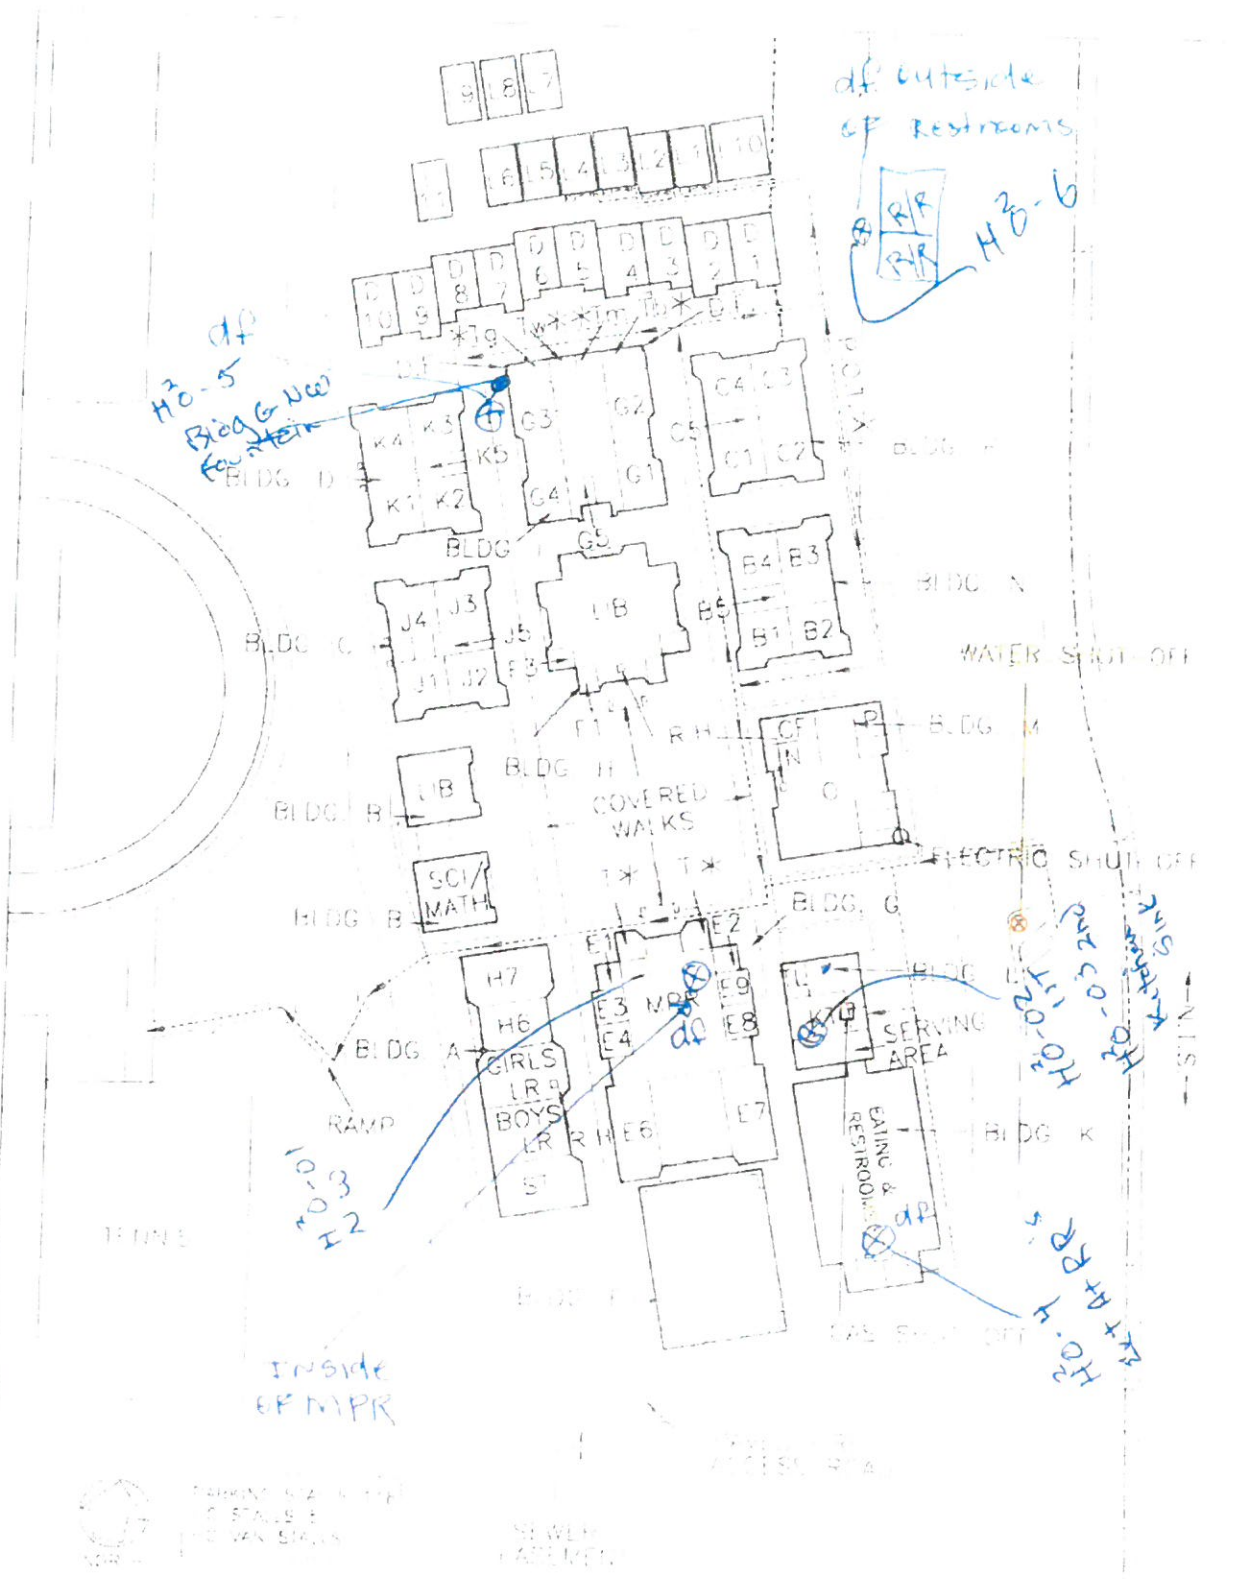

P E R K I N S
& W I L L I

MVA DVA MBE & SDBS
LAW FIRM

Date: 02/07/07
Project Number: 45817
Scale: 1/8" = 1'-0"
Plot Number: 1



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Report Date: 09-Apr-2018

Analytical Report: Page 1 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Van Buren
Elementary School
Work Order Number: B8C2560

Received on Ice (Y/N): No Temp: 13 °C

Attached is the analytical report for the sample(s) received for your project. Below is a list of the individual sample descriptions with the corresponding laboratory number(s). Also, enclosed is a copy of the Chain of Custody document (if received with your sample(s)). Please note any unused portion of the sample(s) may be responsibly discarded after 30 days from the above report date, unless you have requested otherwise.

Thank you for the opportunity to serve your analytical needs. If you have any questions or concerns regarding this report please contact our client service department.

Sample Identification

<u>Lab Sample #</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Sampled</u>	<u>By</u>	<u>Date Submitted</u>	<u>By</u>
B8C2560-01	H2O-1 Kitchen Sink 1st Draw	Water	03/24/18 08:03	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2560-02	H2O-2 Kitchen Sink 2nd Draw	Water	03/24/18 08:05	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2560-03	H2O-3 Bldg B Exterior N Fountain	Water	03/24/18 08:09	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2560-04	H2O-4 Playground Fountain	Water	03/24/18 08:14	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2560-05	H2O-5 Bldg E Exterior N Fountain	Water	03/24/18 08:20	Michael Cohn	03/26/18 09:20	Michael Cohn
B8C2560-06	H2O-6 Room F-2 Fountain	Water	03/24/18 08:25	Michael Cohn	03/26/18 09:20	Michael Cohn

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

T 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
 Contact: Mike Cohn
 Address: 1307 West Sixth Street
 Corona, CA 92882
 Report Date: 09-Apr-2018

Analytical Report: Page 2 of 8
 Project Name: Misc.
 Project Number: Jurupa U. S./Van Buren
 Elementary School
 Work Order Number: **B8C2560**
 Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2560-01

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-1 Kitchen Sink 1st Draw	Water	03/24/18 08:03	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 17:09	MEL	

Mailing
 P.O. Box 432
 Riverside, CA 92502-0432

Location
 6100 Quail Valley Court
 Riverside, CA 92507-0704

P 951 653 3351
 F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
 EPA No. CA00102
 NELAP No. OR4035
 LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 3 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Van Buren
Elementary School
Work Order Number: **B8C2560**

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2560-02

Sample Description

H2O-2 Kitchen Sink 2nd Draw

Matrix

Water

Sampled Date/Time

03/24/18 08:05

Received Date/Time

03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 17:12	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0701

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882

Analytical Report: Page 4 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Van Buren
Elementary School
Work Order Number: **B8C2560**

Report Date: 09-Apr-2018

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2560-03

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-3 Bldg B Exterior N Fountain	Water	03/24/18 08:09	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids							
Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 17:25	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10149



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 5 of 8
Project Name: Misc
Project Number: Jurupa U. S./Van Buren
Elementary School
Work Order Number: B8C2560

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2560-04

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-4 Playground Fountain	Water	03/24/18 08:14	03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 17:28	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0701

P 951 653 3351
F 951 653 1862
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR1035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 6 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Van Buren
Elementary School
Work Order Number: B8C2560

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number

B8C2560-05

Sample Description

H2O-5 Bldg E Exterior N Fountain

Matrix
Water

Sampled Date/Time
03/24/18 08:20

Received Date/Time
03/26/18 9:20

Analyte(s)	Result	RDL	Units	Method	Analysis Date	Analyst	Flag
Metals and Metalloids Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 17:30	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92862
Report Date: 09-Apr-2018

Analytical Report: Page 7 of 8
Project Name: Misc.

Project Number: Jurupa U. S./Van Buren
Elementary School

Work Order Number: B8C2560

Received on Ice (Y/N): No Temp: 13 °C

Laboratory Reference Number
B8C2560-06

<u>Sample Description</u>	<u>Matrix</u>	<u>Sampled Date/Time</u>	<u>Received Date/Time</u>
H2O-6 Room F-2 Fountain	Water	03/24/18 08:25	03/26/18 9:20

<u>Analyte(s)</u>	<u>Result</u>	<u>RDL</u>	<u>Units</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>	<u>Flag</u>
Metals and Metalloids Lead	ND	5.0	ug/L	EPA 200.8	04/02/18 17:33	MEL	

mailing
P.O. Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. 0R4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp, Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 8 of 8
Project Name: Misc.
Project Number: Jurupa U. S./Van Buren
Elementary School
Work Order Number: **B8C2560**
Received on Ice (Y/N): No Temp: 13 °C

Notes and Definitions

- ND: Analyte NOT DETECTED at or above the Method Detection Limit (if MDL is reported), otherwise at or above the Reportable Detection Limit (RDL)
- NR: Not Reported
- RDL: Reportable Detection Limit
- MDL: Method Detection Limit
- * / " " : NELAP does not offer accreditation for this analyte/method/matrix combination

Approval

Enclosed are the analytical results for the submitted sample(s). Babcock Laboratories certify the data presented as part of this report meet the minimum quality standards in the referenced analytical methods. Any exceptions have been noted.

Albert Trujillo For Cindy A. Waddell

cc:

e-Short_No Alias.rpt

This report applies only to the sample(s) analyzed. As a mutual protection to clients, the public, and Babcock Laboratories, Inc., this report is submitted and accepted for the exclusive use of the Client to whom it is addressed. Interpretation and use of the information contained within this report are the sole responsibility of the Client. Babcock Laboratories, Inc. is not responsible for any misinformation or consequences that may result from misinterpretation or improper use of this report. This report is not to be modified or abbreviated in any way. Additionally, this report is not to be used in whole or in part in any advertising or publicity matter without written authorization from Babcock Laboratories, Inc. The liability of Babcock Laboratories, Inc. is limited to the actual cost of the requested analysis, unless otherwise agreed upon in writing. There is no other warranty expressed or implied.

mailing
P.O. Box 452
Riverside, CA 92502-0452

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951 653 3351
F 951 653 1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LACSD No. 10119



BABCOCK Laboratories, Inc.
The Standard of Excellence for Over 100 Years

Client Name: AAA Lead Consultants & Insp. Inc.
Contact: Mike Cohn
Address: 1307 West Sixth Street
Corona, CA 92882
Report Date: 09-Apr-2018

Analytical Report: Page 1 of 1
Project Name: Misc.
Project Number: Jurupa U. S./Van Buren
Elementary School
Work Order Number: **B8C2560**

Received on Ice (Y/N): No Temp: 13 °C

Chain of Custody & Sample Information Record

Client: AAA Lead Consultants and Inspections, Inc. Contact: Michael P. Cohn Fax No. _____
 Phone: (951) 652-6074 Email: aaalead@slsloglobal.net
 Project: Jurupa Unified School District Turn Around Time: Routine 72 Hour Rush 48 Hour Rush 24 Hour Rush
 Inspector: Catherine Deschamps Lab TAT Approval: By: _____ Additional Charges Apply

Additional Reporting Options:
 Raw Data Package Raw Data
 FAX Report CD/DVD
 Hard Disk CD/DVD
 Soft Copy CD/DVD
 Other (Specify Below)

Sample ID	Date	Time	Preservatives						Total # of Containers	Sample Type				Analysis Requested	Matrix	Notes
			Unpreserved	HCl	HNO ₃	H ₂ SO ₄	NaOH	NaOH/Zn Acetate		NH ₄ Cl	MCAA	Routine	Resample			
H2O-1 Kitchen Sink 1st Draw	3/24/18	08:03							1						DW	
H2O-2 Kitchen Sink 2nd Draw	3/24/18	08:05							1						DW	
H2O-3 Blog B Exterior N Fountain	3/24/18	08:05							1						DW	
H2O-4 Playground Fountain	3/24/18	08:14							1						DW	
H2O-5 Blog E Exterior N Fountain	3/24/18	08:20							1						DW	
H2O-6 Room F 2 Fountain	3/24/18	08:25							1						DW	

Signature: _____ Title: _____ Date/Time: _____ Received By: _____ Print Name / Company: _____

Sample Information:
 Sample Name: _____
 Sample ID: _____
 Sample Location: _____
 Sample Date: _____
 Sample Time: _____
 Sample Volume: _____
 Sample Container: _____
 Sample Preservation: _____
 Sample Analysis: _____
 Sample Storage: _____
 Sample Transport: _____
 Sample Receipt: _____
 Sample Release: _____
 Sample Signature: _____
 Sample Date: _____

Page: _____ of _____

mailing
P O Box 432
Riverside, CA 92502-0432

location
6100 Quail Valley Court
Riverside, CA 92507-0704

P 951-653-3351
F 951-653-1662
www.babcocklabs.com

CA ELAP No. 2698
EPA No. CA00102
NELAP No. OR4035
LAOUSD No. 10119

SCHOOL CAMPUS SITE PLANS
JURUPA UNIFIED SCHOOL DISTRICT

DATE: 02/05/02
PROJECT NUMBER: 43814.00
SCALE: 1" = 100'

DATE: 02/05/02
PROJECT NUMBER: 43814.00
SCALE: 1" = 100'

EXISTING CONDITIONS
W.T. GUREN ELEM. SCHOOL

W T GUREN ELEM SCHOOL
EXISTING CONDITIONS
PROJECT NUMBER: 43814.00
SCALE: 1" = 100'

PARKING STALLS 42
NO VAN STALLS-2

